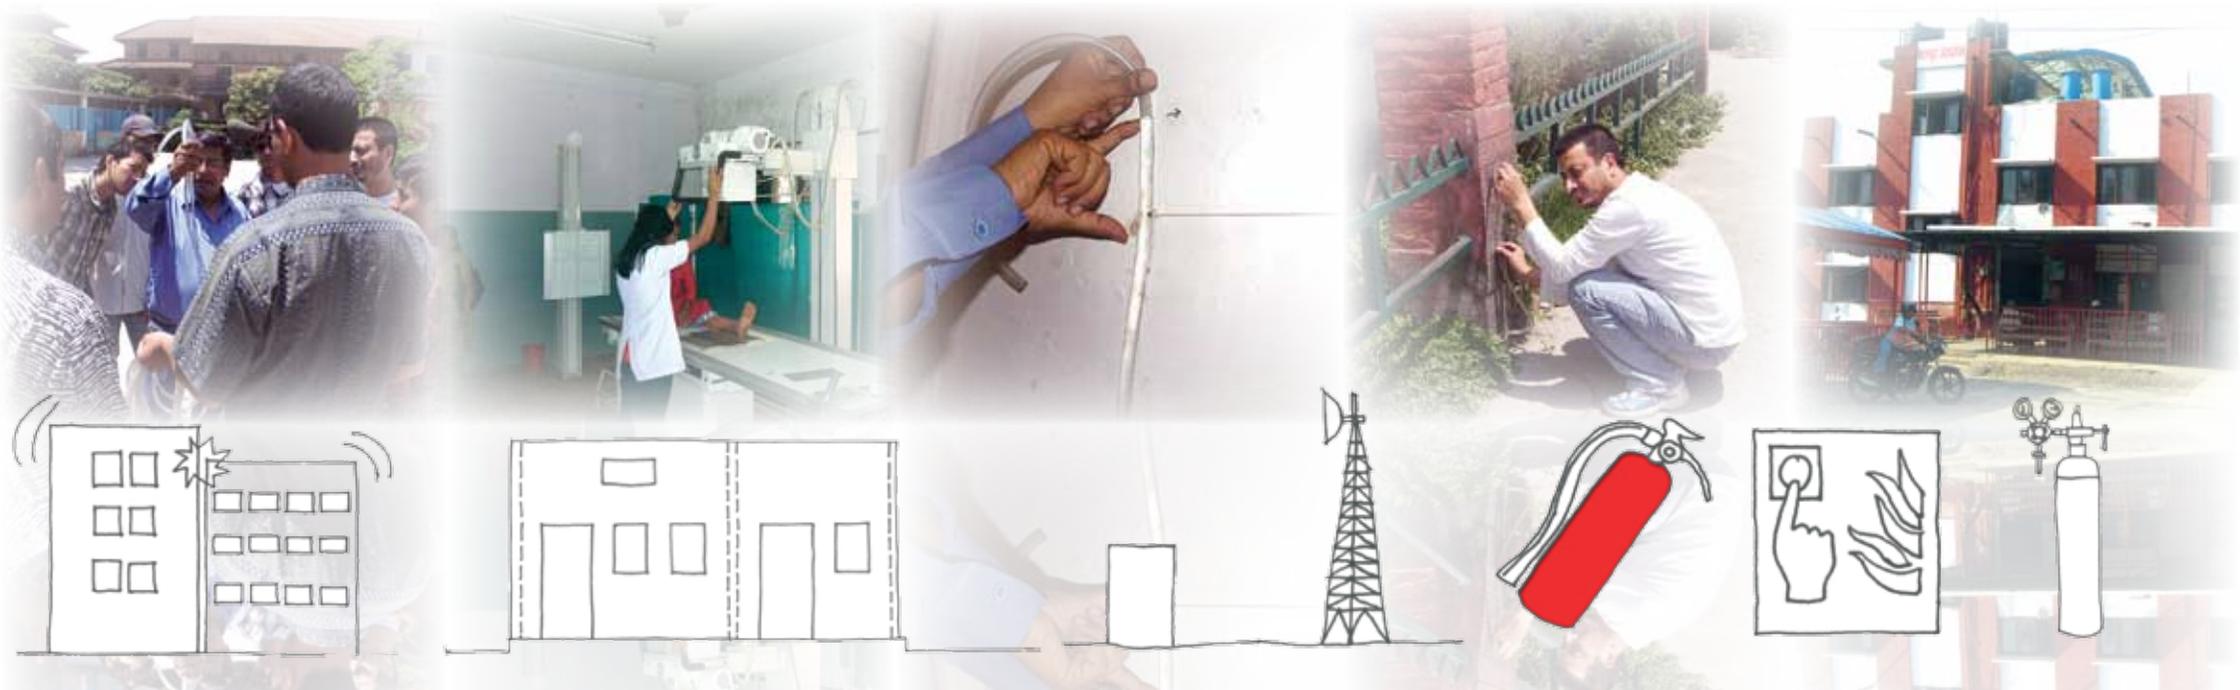


TOOLS FOR THE ASSESSMENT OF SCHOOL AND HOSPITAL SAFETY FOR MULTI-HAZARDS IN SOUTH ASIA

HOSPITAL SAFETY **TOOLKIT BOOK 2: RETRO MAINTENANCE** MULTI-HAZARD SAFETY COMPLIANCE





TOOLS FOR THE ASSESSMENT OF SCHOOL AND HOSPITAL SAFETY FOR MULTI-HAZARDS IN SOUTH ASIA

HOSPITAL SAFETY 
TOOLKIT BOOK 2: RETRO MAINTENANCE
MULTI-HAZARD SAFETY COMPLIANCE

Copyright © United Nations Human Settlements Programme (UN-Habitat) and United Nations Office For Disaster Risk Reduction (UNISDR), 2012

All rights reserved

United Nations Human Settlements Programme (UN-Habitat)
Regional Office for Asia and the Pacific
ACROS Fukuoka Building, 8th Floor
1-1-1 Tenjin, Chuo-ku, Fukuoka 810-0001, Japan
Tel: +81-92 724-7121 / 23
Fax: +81-92 724-7124
E-mail: habitat.fukuoka@unhabitat.org
Website: www.unhabitat.org, www.fukuoka.unhabitat.org

United Nations Office for Disaster Risk Reduction (UNISDR)
Asia Pacific Secretariat
United Nations Secretariat Building
Rajdamnern Nok Avenue, 10200 Bangkok, Thailand
Phone: +66 -2 288-2745
E-mail: isdr-bkk@un.org
Website: <http://www.unisdr.org/asiapacific>

DISCLAIMER

The designations employed and the presentation of the material in this publication do not imply the expression of any opinion whatsoever on the part of the Secretariat of the United Nations concerning the legal status of any country, territory, city or area, or of its authorities, or concerning delimitation of its frontiers or boundaries, or regarding its economic system or degree of development. The analysis, conclusions and recommendations of the Toolkit do not necessarily reflect the views of the United Nations Human Settlements Programme (UN-Habitat), United Nations Office for Disaster Risk Reduction (UNISDR), and the Governing Council or its Member States.

Reference to names of firms and commercial products and processes do not imply their endorsement by the United Nations.

Excerpts from this publication, excluding photographs, may be reproduced without authorization, on condition that the source is indicated.

This publication was issued without formal editing.

HS Number: HS/092/12E
ISBN Number: 978-92-1-133401-2 (Series)
ISBN Number: 978-92-1-132507-2 (Volume)

Cover design: Peu Banerjee Das and Ilija Gubic

Design & Print Production: wps, tel +977-1-5550289, email printnepal@gmail.com

ACKNOWLEDGEMENTS

The Toolkit is a joint effort by the United Nations Human Settlements Programme Regional Office for Asia and the Pacific (UN-Habitat ROAP) and the United Nations Office for Disaster Risk Reduction (UNISDR) Asia Pacific Secretariat in partnership with the South Asian Association for Regional Cooperation Disaster Management Centre (SDMC).

The expert inputs from the SDMC were provided by O. P. Mishra, M. B. Rao and Mriganka Ghatak under the guidance of Satendra, Director SDMC. The preparation of the publication was coordinated by Mariko Sato, UN-Habitat and Madhavi Malalgoda Ariyabandu, UNISDR, supported by the team comprising Padma Sunder Joshi, Ilija Gubic, Pornpun Pinweha, under the guidance of Toshi Noda, former Regional Director, UN-Habitat ROAP; Hang Thi Thanh Pham and Nasikarn Nitiprathananun, under the guidance of the Senior Regional Coordinator, UNISDR Asia Pacific Secretariat, German Velasquez.

The lead technical advisor for developing the Toolkit is Prabir Kumar Das. Drawings in the Toolkit were contributed by Peu Banerjee Das.

The Governments of India, Nepal and Pakistan rendered a wide range of support. The Toolkit benefitted from technical inputs from ADB Nepal, UNDP India, UNESCO Pakistan, UN-Habitat Nepal and UN-Habitat Pakistan, WHO Nepal and the Nepal Risk Reduction Consortium (NRRRC).

Peer Reviewers

The following experts contributed to the Toolkit with reviews of earlier drafts: Manohar Lal Rajbhandari, Rajan Suwal, Jishnu Subedi, Ramesh Guragain, Sunil Khadka, Chandan Ghosh, and Ranjini Mukherjee.

Expert Group Meeting, March 25-26, 2012, Kathmandu, Nepal

The earlier drafts of the Toolkits were reviewed by the following experts at the EGM: Damodar Adhikary, Mukunda Adhikari, Lin Aung, Deepak Raj Bhatt, Tanka Prasad Bhattarai, Bal Krishna Bhusal, Tirtharaj Burlakoti, P. B. Chand, Meen Bahadur Chhetri, Tulsi Prasad Dahal, Mriganka Ghatak, Ramesh Guragain, Sabina Joshi, Sagar Joshi, Sunil Khadka, Hamid Mumtaz Khan, Sardar Muhammad Nawaz Khan, Sarosh Hashmat Lodi, Ram Luetel, Arun Mallik, Rajesh Manandhar, Prem Nath Maskey, Abha Mishra, Giridhar Mishra, Prafulla Man Singh Pradhan, Manohar Lal Rajbhandari, Shreejana Rajbhandari, Moira Reddick, Sujata Saunik, Gyanandra Shakya, Arinita Maskey Shrestha, Deepak Shrestha, Hari Darshan Shrestha, Rekha Shrestha, Santosh Shrestha, Sudha Shrestha, Tulasi Sitaula, Paolo Spantigati, Jishnu Subedi, Rajan Suwal, Kishore Thapa, Man Bahadur Thapa, Bhushan Tuladhar, Sainendra Uprety, Jhapper Singh Vishokarma and Syed Arsalan Sabah Zaidi. UN-Habitat Nepal Office team has provided the logistic support.

Field Testing of the Toolkits in India, Nepal and Pakistan has contributed to the modification of the draft tools. Tools were tested in Guwahati and Shimla in India, Bhaktapur, Kirtipur and Lalitpur in Nepal, with help of Santosh Shrestha, as well as in Raheem Yar Khan, Punjab in Pakistan.

The preparation of the Toolkit has drawn upon the existing tools and good practices including materials shared by UNESCO Pakistan, UNDP India, WHO, PAHO, ADB, National Institute of Disaster Management (NIDM) India, Nepal Risk Reduction Consortium (NRRRC), National Society for Earthquake Technology (NSET) Nepal, Nepal Health Sector Support Programme, UN-Habitat Myanmar, Nepal and Pakistan Offices.

UN-Habitat and UNISDR are grateful for the financial support provided by the Global Facility for Disaster Reduction and Recovery (GFDRR).

FOREWORD

South Asia is a hotspot of disasters. The tectonic, geomorphological and hydro meteorological set up of the region along with socio- economic conditions make it extremely vulnerable to various natural disasters. The South Asian countries located in the seismically active northern fringes like Afghanistan, Bhutan, India, Nepal and Pakistan have been witness to several devastating earthquakes in the past. Similarly, the countries with exposed coastline like Bangladesh, India, Maldives and Sri Lanka have borne the fury of cyclones, tsunamis and coastal erosion. In addition to these, floods, landslides, droughts have also caused devastation in the countries of South Asia.

It has been observed that in case of natural disasters the important community and lifeline structures such as schools and hospitals receive irrecoverable damages and it takes a long time to restore them to function for the communities. The safety of these structures becomes even more important in light of the fact that, when disasters strike, they also serve as vital centers for community shelter extended to the affected. The safety and resilience of lifeline structures and a strong need to adopt a toolkit which addresses the critical aspects of safety of schools and hospitals in vulnerable areas thus has been identified as a priority. South Asian Association for Regional Cooperation (SAARC) Disaster Management Centre (SDMC), New Delhi India identified the vitality of the issue and in follow up to the SAARC Road Map for Earthquake Risk Mitigation; a toolkit for Rapid Visual Assessment (RVA) of schools and hospitals has been developed in 2011.

Extending this initiative further, UN-Habitat, in partnership with UNISDR Asia Pacific Secretariat and the SDMC has taken up the mission of developing a standardized Tool Kit for the assessment of safety of school and hospital structures to multiple hazards in the region. This Tool Kit adopts the basic framework from the SDMC template on Risk and Vulnerability Analysis of Schools and Hospitals, and extends to the multiple hazards, the region is prone to such as earthquake, flood, cyclone, fire etc.. It addresses the safety of new lifeline structures as well as retrofitting of existing structures to make them resilient and safe for the communities during disasters. The Tool Kit targets two groups placed at the extreme ends of disaster management spectrum: the Top Level Management and the End Users. The

development of the Tool Kit has undergone several rigorous stages of review and feedback from experts from the region and field observations. Finally at a stimulating Expert Group Meeting (EGM) held in Kathmandu a distinguished panel of experts assembled and deliberated on the finer technical aspects. Incorporation of the recommendations of the EGM has further enriched the contents of the Tool Kit.

The Tool Kit is placed in the hands of the intended users at a very crucial juncture of disaster risk reduction initiatives evolving in the SAARC region, through various consultative, research and policy planning endeavours. It is expected that the Tool Kit will be useful to a myriad cross section of players engaged in disaster risk reduction in the SAARC region.



A handwritten signature in black ink, appearing to read 'Satendra', written over a horizontal line.

Satendra
Director
SAARC Disaster Management Centre

FOREWORD

It gives us great pleasure to introduce this toolkit entitled **Tools for the Assessment of School and Hospital Safety for Multi-Hazards in South Asia.**

South Asia is one of the most disaster prone regions in the world. A combination of multiple layers of geo-physical and climatic hazards, as well as a complex range of physical, social and economic vulnerabilities contribute to this. In 40 years, from 1967 – 2006, some 784 reported disasters took 800,000 lives and affected over two billion people. Economic losses amounted to an estimated \$80 billion. This region also has an exceptionally high annual urban growth rate, with the accompanying challenges of increased urban risk and vulnerability.

Six out of the eight countries of South Asia - Afghanistan, Pakistan, India, Nepal, Bhutan and Bangladesh, are located in the highly seismically active Himalayan-Hindu Kush belt. Sri Lanka, Maldives and large parts of the coastal areas of Bangladesh, India and Pakistan are vulnerable to tsunamis, cyclones and flooding. Substantial damages were caused to education and health facilities by a series of disasters in the recent years such as the 2004 Indian Ocean Tsunami, the 2005 Kashmir earthquake, Cyclone Sidr in 2007, and the 2010 and 2011 floods in Pakistan. The resultant loss of life of students, teachers and health workers, and the collapse of school and hospital buildings clearly indicate the need to ensure the safety of these critically important facilities.


This toolkit, which comprises four sets of assessment tools for both existing and new schools as well as hospitals, is a result of cooperation amongst the South Asian Association for Regional Cooperation (SAARC), the United Nations Human Settlements Programme (UN-Habitat) and the United Nations Office for Disaster Risk Reduction (UNISDR).

The Toolkit serves Afghanistan, Bangladesh, Bhutan, India, Maldives, Nepal, Pakistan and Sri Lanka, and complements the recent work of the SAARC Disaster Management Centre and its publication '*Rapid Structural and Non-Structural Assessment of School and Hospital Buildings in SAARC Countries*'. The aim is to offer user-friendly tools for the multi-hazard context of South Asia, targeting policy makers, experts, and end-users responsible for local level planning and implementation.

The toolkit explains the complex process of retrofitting existing facilities as well as ensuring safe construction of new infrastructure in a practical manner. It facilitates informed decision-making and actions to achieve school and hospital safety. Importantly, the tools have been reviewed by a group of experts including policymakers, professionals and users, and have undergone field testing in several locations in India, Nepal and Pakistan.

This new approach will provide concrete indices in support of the recommendations of the 2011 Chair's summary of the Global Platform for Disaster Risk Reduction, the global advocacy campaigns: *One Million Safe Schools and Hospitals, Making Cities Resilient - My City is Getting Ready and, the World Urban Campaign*. We believe this is an important step towards achieving risk reduction targets and building the resilience of nations and communities in the South Asian sub-continent. The toolkit demonstrates that making critical infrastructure safe from disasters is achievable.




Joan Clos,
UN Under-Secretary-General and
Executive Director, UN-Habitat - United
Nations Human Settlements Programme




Margareta Wahlstrom,
UN Special Representative
of the Secretary-General
for Disaster Risk Reduction
(DRR), UNISDR



SCHOOL SAFETY
TOOLKIT BOOK 1: NEW DESIGN
Multi-Hazard Safety Compliance

- CHAPTER 1
 1.1 Background
 1.2 The Toolkits
 1.3 Who does what and how
 1.4 Types Of Hazards
 1.5 Desktop Research
 1.6 Process

- CHAPTER 2
 2.1 How to Use the Toolkit I

- Annexure I: Seismic Safety Evaluation
 Annexure II: Wind Safety Evaluation
 Annexure III: Flood Safety Evaluation
 Annexure IV: Fire Safety Evaluation

CONSULTANTS WILL
 FILLIN TOOLKIT I &
 PRESENT IT TO TLM,
 EDUCATION



SCHOOL SAFETY
TOOLKIT BOOK 2: RETRO MAINTENANCE
Multi-Hazard Safety Compliance

- CHAPTER 1
 1.1 Background
 1.2 The Toolkits
 1.3 Who does What and How
 1.4 Types Of Hazards
 1.5 Desktop Research
 1.6 Process

- CHAPTER 2
 2.1 How to Use the Toolkit II

- CHAPTER 3
 3.1 General Information: School

- Annexure I: Seismic Safety Evaluation
 Annexure II: Wind Safety Evaluation
 Annexure III: Flood Safety Evaluation
 Annexure IV: Fire Safety Evaluation
 Annexure V: Supplement:School
 Condition Assessment Support to EMIS
 Annexure VI: Field Test

SURVEY AGENCY/NGO
 WILL FILLIN TOOLKIT II
 & PRESENT IT TO TLM,
 EDUCATION

TEACHERS+SMC WILL
 FILL IN SUPPLEMENT,
 A SUPPORT TO EMIS
 & PRESENT IT TO TLM,
 EDUCATION

CONTENTS

THERE ARE FOUR
 INDEPENDENT BOOKS ON
 MULTI HAZARD SAFETY
 COMPLIANCE ASSESSMENT
 OF NEW DESIGN AND
 EXISTING HOSPITALS AND
 SCHOOLS

THIS IS BOOK 2



HOSPITAL SAFETY
TOOLKIT BOOK 1: NEW DESIGN
Multi-Hazard Safety Compliance

- Chapter 1
 1.1 Background
 1.2 The Toolkits
 1.3 Who does what and how
 1.4 Types of Hazards
 1.5 Desktop Research
 1.6 Process

- Chapter 2
 2.1 How to Use the Toolkit I

- Annexure I: Seismic Safety Evaluation
 Annexure II: Wind Safety Evaluation
 Annexure III: Flood Safety Evaluation
 Annexure IV: Fire Safety Evaluation

CONSULTANTS WILL
 FILLIN TOOLKIT I &
 PRESENT IT TO Top
 Level Management
 (TLM), HEALTH



HOSPITAL SAFETY
TOOLKIT BOOK 2: RETRO MAINTENANCE
Multi-Hazard Safety Compliance

- Chapter 1 3
 1.1 Background 3
 1.2 The Toolkits 3
 1.3 Who does what and how 4
 1.4 Types of Hazards 4
 1.5 Desktop research 4
 1.6 Process 4

- Chapter 2: 5
 2.1 How to use the Toolkit II 5

- Chapter 3 11
 3.1 General information: Hospital 11

- Annexure I: Seismic Safety Evaluation 15
 Annexure II: Wind Safety Evaluation 29
 Annexure III: Flood Safety Evaluation 38
 Annexure IV: Fire Safety Evaluation 44
 Annexure V: Supplement to Toolkit II:
 Hospital Condition Assessment:
 Support to HIIS 49
 Annexure VI: Field Test 59

SURVEY
 AGENCY/NGO
 WILL FILL IN
 TOOLKIT II &
 PRESENT IT TO
 TLM, HEALTH

MEDICAL
 STAFF WILL
 FILL IN
 SUPPLEMENT,
 A SUPPORT
 TO HIIS &
 PRESENT IT TO
 TLM, HEALTH

GLOSSARY

Buoyancy effect: Sometimes, floodwater level in a place may rise considerably higher than the bottom of a building's basement or an underground tank. In such case, the building or the water tank will experience upward push. This is called buoyancy. Such movement may cause a breaking and/or separation of the connecting pipes and other service lines

Design flood elevation is a regulatory flood height level adopted by a community at local level. Such level is based on observed data for a long time. It helps to determine the safe plinth height of buildings in a flood prone area.

Drift is the horizontal displacement of a building due to seismic, wind or any other horizontal force


Ductility: Any metal that has the ability to get stretched without being damaged is a ductile material and this property of materials is called ductility. Mild steel, copper, etc. are ductile materials.

Fault is a discontinuity in a volume of rock, across which there has been significant displacement as a result of earth movement. A fault is called active if it is likely to have another earthquake in future. Faults are commonly considered to be active if they have moved one or more times in the last 10,000 years.

Frame structure is the skeleton of a building made of wood, steel, or reinforced concrete that supports all kinds of loads. In a frame structure load is transferred from slabs → beams → columns → foundation. All member joints in framed structure can withstand bending.


Geotechnical investigation is performed by geotechnical engineers or engineering geologists to obtain information on the physical properties of soil and rock around a site to design earthworks and building foundations.

Grid is defined principally by column positions and the main beams spanning between them. The sketch on the right is a building plan showing column locations. The dotted lines are the grids.



Liquefaction is a state in which un-compacted saturated soil acts more like a dense liquid than solid during earthquake. Water saturated granular soil such as silts, sands, and gravel that are free of clay particles are prone to liquefaction. Buildings undergo severe damage/sinking when the soil beneath suddenly behaves like a liquid due to liquefaction.

Load path means a path that forces pass through to the foundation of a structure. A continuous load path is like a chain that ties the house together from the roof to the foundation. The sketch on the right shows a discontinuous load path, which is not good for seismic or wind load.



Masonry structure: When brick, stone, blocks, etc are laid in courses with cement/lime/mud mortar as bed is called a masonry structure. Usually used in wall, roof, etc.

Reinforced Cement Concrete (RCC): Concrete consists of cement, sand, aggregate and water. The solid portions are first mixed thoroughly and then water is added and then mixed further. This is cast with mild steel rods embedded inside. It is called RCC when it turns solid. RCC can take both tension and compression.

Retaining wall is built in order to hold back earth which would otherwise move downwards.


Seismic load is caused due to earthquake-generated agitation to a building or structure. Seismic load acts at contact surfaces of a structure either with the ground http://en.wikipedia.org/wiki/Seismic_loading - cite_note-1, or with adjacent structures

Seismic micro zoning is the process of subdividing an earthquake prone area into zones with respect to geological and geophysical characteristics of the sites. It provides information on ground shaking, liquefaction susceptibility, landslide and rock fall hazard, earthquake-related flooding. Seismic micro zoning maps of construction areas must be consulted when designing earthquake-resistant structures

Seismic zone is a region in which the rate of seismic activity remains fairly consistent. e.g. IS 1893, 2002 shows that there are four seismic zones in India- Zone V, the severest earthquake prone and Zone II the least.

Short column effect: Column heights within the same storey could be different if a building is on a slope or if there is a part mezzanine floor within the

storey. In such case the columns of shorter heights are stiffer and attract more earthquake forces than the taller ones. If not designed adequately, the shorter ones may fail, which is attributed as failure due to short column effect.



Storm surge is an offshore rise of water due to a low pressure weather system, e.g., during cyclones. Storm surges are caused primarily by high winds pushing on the ocean's surface. The wind causes the water to pile up higher than the ordinary sea level. This could be highly damaging for the buildings along coast lines.

Tsunami, in Japanese, is "harbour wave". It is a series of water waves caused by the displacement of

a large volume of water in an ocean or a large lake. The various reasons for tsunami could be earthquakes, volcanic eruptions and other underwater explosions, landslides, meteorite impacts etc.

Unreinforced masonry is a type of building where the structural walls are made of brick, block, tiles, adobe or other masonry material, that is not braced by reinforcing rods.

Wind born missile: If a site has trees, waste bins/cans, debris or other materials that can be moved by the wind, during cyclone or high wind they may fly and strike your building by damaging windows, doors, etc. Elements that can fly in high wind and damage

buildings are called wind borne missiles. One must consider this effect in design.

Wind Tunnel effect: if one takes a walk between tall buildings, or in a narrow mountain pass, one will notice that the wind speed is much higher than the general level. The air becomes compressed on the windy side of the buildings or mountains, and its speed increases considerably between the obstacles to the wind. This is known as a "tunnel effect". If your building site is prone such effect, it must be considered in design.

CHAPTER 1

1.1 BACKGROUND

Major Asian cities are located, by and large, across flood plains or in coastal areas. Over 50% of the urban populations are living in small and medium size cities with less than 500,000 populations that are growing faster and may not be able to cope with emerging urban issues. Considering the increased urban risks many of our cities are facing, it is clear that there is a need to integrate disaster risk reduction into the urban planning and local planning practices.

The Chairs summary of the GPDRR 2009 calls for specific targets to achieve critical infrastructure safety, as stated: *“By 2011 a global structural evaluation of all schools and hospitals should be undertaken and that by 2015 concrete action plans for safer schools and hospitals should be developed and implemented in all disaster prone countries”*.

To respond to such a situation, UN-Habitat Bangkok Office in partnership with UNISDR Asia Pacific Secretariat decided to develop Toolkits which will facilitate the assessment of the safety of critical infrastructure, focusing on schools and hospitals in South Asia.

The obvious question in the beginning was why one needs another toolkit when there is a large body of available technical literature on disaster safe school and hospitals. Detailed examination of the existing literature and interviewing people directly involved with the supply and maintenance revealed that disaster safety of hospitals and schools from the owners’ and users’ perspective is inadequately covered. This is an important area since disaster safety is not just a technical issue; it needs proactive participation of both the owners and end-users in the endeavor of safe schools and hospitals.

Under such circumstance, ***this project viewed the top level management and the end-users as the two most important key role players***. Top level management here means the Director Generals (Health/education) along with the line directors. The end users are the school teachers and the doctors and medical staff at school and hospital respectively.

Any hospital or school is planned, designed, constructed and handed over to the end-users, who use the facilities for at least fifty years before being replaced with a new one. The top level management is responsible for ensuring that the buildings conform to the safety standards throughout their whole life cycle. Safety is a complete package spanning over the entire lifespan of a building.

1.2 THE TOOLKITS

New Construction: For supply of new buildings, while management has to rely on architect(s) and engineers, it is equally important for them to act as **INFORMED CLIENTS** while interacting with the architects and engineers, in the endeavour to make the hospital/ school safe. The focus of the toolkit is to get an idea on the level of compliance of a new design with safety norms/codes/standards. This is possible only if the toolkit is simple, objective type and graphical. It should also be comprehensive enough to suit the busy schedule of the top level management. This has been termed as **TOOLKIT I**.

- The Toolkit I is designed to enhance awareness and capacity of the top level management to take meaningful role in creating safe new hospital and school. The output of the Toolkit I will form part of a national database on safety compliance for

future reference and as a commitment from the architect’s and engineer’s side.

Existing Buildings & Facilities: For the existing buildings, it is most important to know whether they are safe according to the latest building codes, failing which there may be a need for retrofitting. The second important issue is the current physical condition of the existing infrastructure. Buildings tend to live long in a cost effective manner, if maintained periodically.

It may be noted that there is a lack of awareness on retrofitting, though all are aware of maintenance. Currently the data collection system in health and education departments are maintenance-centred. As a result, these two aspects of safety are mostly dealt in isolation. It will be cost effective and consistent with safety if these two are viewed as a single whole - retrofit cum maintenance. To bring in a paradigm shift in this regard, it is important to develop the following;

- A suitable toolkit for the top level management to keep track with the retrofitting requirements of the hospitals and schools - termed as **TOOLKIT II**.
- While Toolkit II will provide a comprehensive picture on the retrofitting requirements, it needs data on existing physical conditions of the buildings to make rationalised decision on retrofit cum maintenance actions. A supplement has been designed to address this.

It addresses two issues, a) makes additions and modifications to the existing **EMIS/HIIS**¹ systems, b) provides a graphical guide book to help the end users to acquire more objective type data

¹ Education Management Information System (EMIS, Health Infrastructure Information System (HIIS))

on maintenance and some aspects of retrofitting within the framework of existing HHS and EMIS forms. The supplement has been designed within the capability of school teachers and medical staff

- The Toolkit II and the Supplement will enable the line directorates to screen those which would need further investigation for retrofitting need assessment by experts. For the rest, the toolkit and the supplement will help in prioritizing the maintenance needs

1.3 WHO DOES WHAT AND HOW

Toolkit I (Multi-Hazard safe New Design: Hospital & School): The appointed architect/ engineer will use toolkit I and report to the top level management on the level of compliance of the design with safety norms. Once top level management is satisfied with the level of safety compliance of design, the filled-in Toolkit I will be archived in the computer for future reference.

Toolkit II: (Multi-Hazard safe Retrofitting: Existing Hospital & School): The top level management will appoint NGO/agency or similar group of people to do the retrofitting need assessment once in three to four years.

Supplement to Toolkit II (The medical staff and the school teachers with school management committee will use this as an extension to the HHS and EMIS data format. This will be done annually.

The toolkit II and the supplement will enable top level management to estimate and prioritize the retrofit cum maintenance works in a holistic manner. This will also enable one to decide whether detailed investigation is required at a particular hospital or school.

1.4 TYPES OF HAZARDS

Since adequate literature is available on seismic, wind, flood and fire hazards, the toolkit had address all four of them.

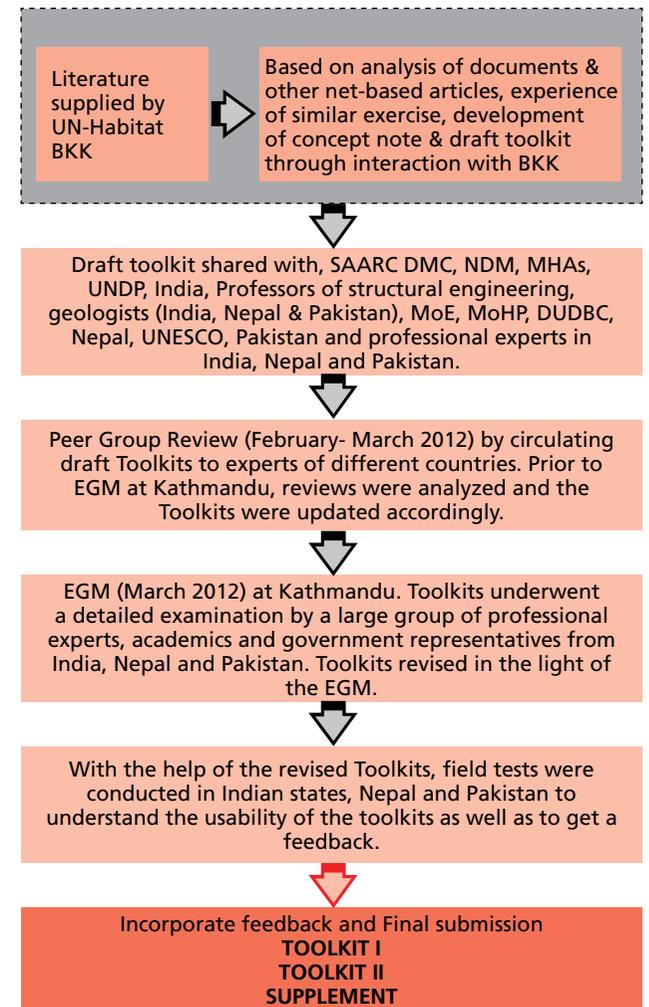
1.5 DESKTOP RESEARCH

The biggest challenge in this project was to identify the area where Toolkit could be developed amidst a large number of existing books, manuals and other literature on safe Hospital and school. Majority of the existing literature in this domain were on seismic safety and primarily addressed to the technical people. Considering the shortage of time for the toolkit development, utmost care was taken to make sure that the optimum amount of documents from the best sources are examined. The Toolkits developed in this publication are heavily indebted to FEMA 577, FEMA P-424, SDMC, NSET, and other sources, which have been put up in the References.

**This is the
Hospital Safety Toolkit Book 2: Retro-
maintenance: Multi-Hazard Safety Compliance**

1.6 PROCESS

Figure 1.1: Diagram showing steps of the toolkit development



CHAPTER 2

2.1 HOW TO USE THE TOOLKIT II (MULTI HAZARD RETRO-MAINTENANCE NEED ASSESSMENT OF HOSPITALS)

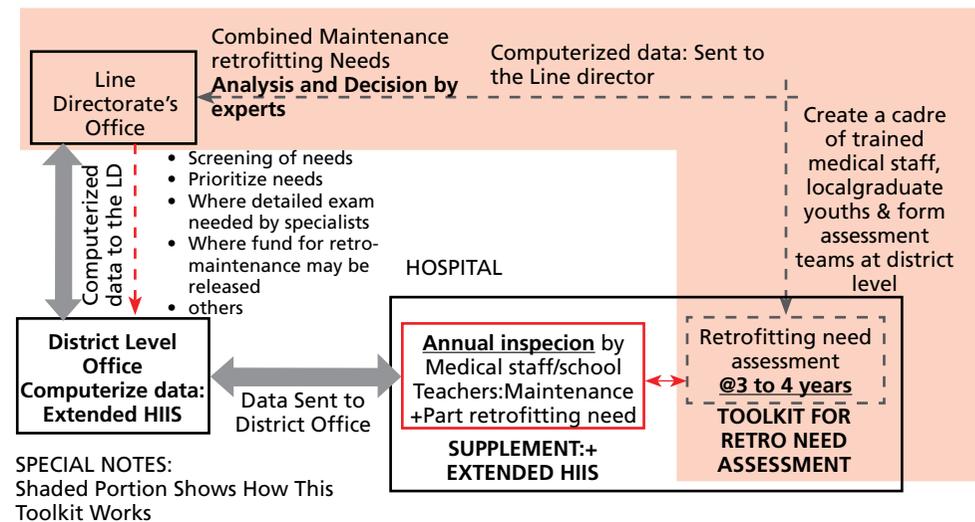
THE TARGET GROUP IT IS FOR THE HEALTH DEPARTMENT'S TOP LEVEL MANAGEMENT (TLM), i.e., LINE DIRECTOR (INFRASTRUCTURE) & TEAM
 This will enable Top Level Management to get a comprehensive idea on retrofitting needs of existing hospitals
 The Toolkit II enables TLM to view retrofitting and maintenance as a combined whole and screen those where detailed exam is needed

A What does the Toolkit II do?

- The Toolkit II evaluates MULTI-HAZARD Retrofitting need of Hospital at a particular site
- It uses a checklist to calculate the safety compliance level of hospitals based on a semi-objective method

B How does the management system work?

- A cadre of trained medical staff, local science graduate youths could be formed at district level to assess retrofitting needs with Toolkit II
- The survey team will visit the site, then fill in answers against each key question of Toolkit II to evaluate its multi hazard retrofitting needs
- This Toolkit enables TLM to know the compliance index of any hospital. It also shows items which need retrofitting in the building and facilities
- Toolkit II will enable the TLM to screen out hospitals which are safe & investigate those where compliance level is below acceptable safety level (say 0.75)
- This will be stored in computerised database of Health Ministry as a record for all future planning
- The above steps have been summarised in the shaded portion of Figure on the right
- Since retrofit cum maintenance is the objective, working process of this ToolkitII (shown in shade) is shown with Health & Education department's regular system of maintenance data collection
- The existing maintenance data collection forms have been extended and a supplement has been designed, which has been put in **Chapter** on SUPPLEMENT
- This Toolkit + Supplement will enable the TLM & experts to make decisions on retro-maintenance



Rest of the Figure Shows Maintenance data collection Mechanism of Ministry of Health

C How does a designer use the Toolkit II?

- Safety compliance of an existing building is evaluated by answering CHECKLISTS in four worksheets 1) Seismic, 2) Wind, 3) Flood, 4) Fire
- Fill in the checklists of only those hazards which are relevant your project at a particular place, e.g., in Delhi, seismic, flood and fire will be relevant
- Take a worksheet, e.g. Seismic: Go through Column B "KEY QUESTIONS..." one by one. The page looks as follows- Read the top line, it is self-explanatory

READ THIS BEFORE ANSWERING THE KEY QUESTIONS

	User will read the following key questions in this column	Against Key Question, the User will choose the appropriate answer from the given options shown in this column	Users Input 1	Specialists can alter scale of key question specific scoring	Specialists can change key question specific importance	DO NOT CHANGE THESE AT ALL			User's Input 2: Follow the instructions in column C and type in the necessary information in this column
A	B	C	D	E	F	G	H	I	J
EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES+OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	Compliance Status 0-1	Issue Imporatnce VI, I, LOW	Weighted Compliance C3XC4	Ideal Case	Compliance index	REFERENCES/REMARKS
PLANNING								0.49	
P1	<p>Have you done (or referred to a) geological investigation report to know if there is an active major fault on or adjacent to your proposed hospital site?</p> <p>Special note: Consult local building department, State geologist, local university, or local geotechnical expert.</p>	<p>If you have done/referred to geological investigations write the source in column "REFERENCES/REMARKS" and then choose one from the following options</p> <p>Type "NA" if geological investigation has been referred to, which shows that the issue of fault line is not applicable in your case</p> <p>Type 0, if you haven't done or referred to geological investigation for your site</p> <p>Type 1, if the fault line is < 500m away from the site</p> <p>Type 2, if the fault line is between< 1000m away from the site</p> <p>Type 3, if the fault is > 1000m away from the site</p>	1	0.75	VI	20.25	27		
The surveyor will read the key questions in columnB first. Based on the "GUIDANCE NOTES....." in Column C, surveyor will write the answer in column D									
The calculations for compliance index is done automatically									
Column E and F should not be altered by the surveyor- it is strictly for the experts only.									
Wherever instructed in the column C, the surveyor will write the requisites in column J "REFERENCES/REMARKS"									
When one completes answering all issues under one category, e.g., Planning, the Compliance Index for Planning appears in column I									
Repeat the process of answering questions in the remaining categories, viz., Architectural, Structural and Non-structural									
Once you have answered all five categories of worksheet "SEISMIC", proceed to the next relevant worksheets and repeat the process									

D On completion of this process go to the last worksheet "SUMMARY"--> you will see the following chart

WRITE NA TO THOSE HAZARDS WHICH NOT RELEVANT TO YOUR SITE

HAZARD SAFETY COMPLIANCE MATRIX				
is this hazard → applicable at your site?	Applicable	Applicable	Applicable	Applicable
	MULTI HAZARD WEIGHTED COMPLIANCE			
	Seismic	Wind	Flood	Fire
Planning	0.49	NA	NA	0.38
Architectural	0.48	NA	NA	0.34
Structural	0.20	NA	NA	0.25
Non structural	0.15	NA	NA	0.17
Multi Hazard compliance index	0.36			
Overall CI	0.43	0.00	0.00	0.28
	1.00	0.00	0.00	1.00

E There are four specialists' control in worksheet "SUMMARY" - each country to make country-specific modifications

ISSUE IMPORTANCE SPECIALIST TO MODIFY THESE ↓ 1	
VI	27
I	9
LI	3

Each key question has an importance VI/I/LI. Specialists to determine this to suit country specific context. Type VI/I or LI against each key question in column F of worksheet 1 to 4. These values may be modified in "SUMMARY", Table at G22

CATEGORY WEIGHT ↓ 2	
0.2	Planning
0.3	Architectural
0.3	Structural
0.2	Non-structural

D14-E14-F14-G14 in "SUMMARY" calculates the overall compliance index based on category weight in Table at J23. Specialists may change these for each country

VI→Very Important, I→Important, LI→low importance
Compliance Index

SPECIALIST TO MODIFY THESE ↓ 3	
not addressed	0
low	0.25
medium	0.5
high	0.75
1 completely addressed	1

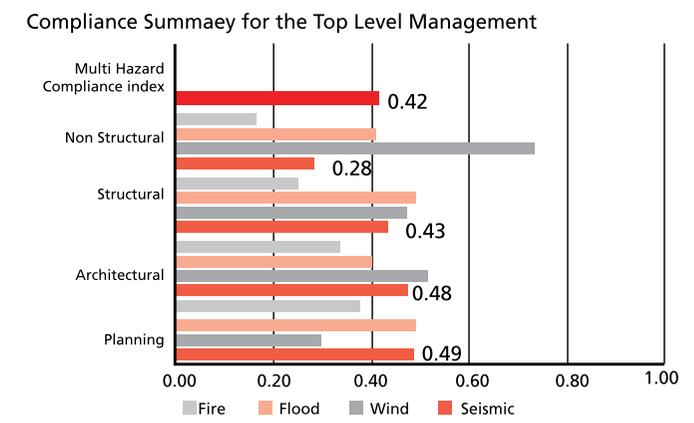
Scale of scoring
1. the one shown in the Table of 5 options
2. Similar linear scale with 3 to 4 options
3. non linear variation of type 1 & 2
4. Binary scale of "0" or "1"

Specialists may change these pattern of scoring in column "E" of worksheet 1,2,3,4

COUNTRY SPECIFIC HAZARD WEIGHTS ↓ 4	
W seis	1
Wwind	1
Wflood	1
Wfire	1

These will depend upon hazard frequency & magnitude of a country Specialists will make country specific hazard weights in Table at J28 of "SUMMARY"

F	Final output for the Top Level Management
	<ul style="list-style-type: none"> When a surveyor answers all four CHECKLISTS, the compliance indexes will be automatically Once you have filled in all the relevant worksheets, go to worksheet SUMMARY- you will see the chart on the ri The surveyor will present this chart to the Top Level Management In case the compliance of a category is not 1 , the surveyor will explain the reasons as shown in the Gap Matrix shown below



G The following list is automatically generated showing where gaps exists. This will show where to work on to enhance the category score (planning/architectural/structural/non-structural issues)

Special Note: The Compliance Level Cut Off is a joint decision of the TLM and the specialists- it could be modified in E39 in "SUMMARY"

TLM MAY ↓ MODIFY THIS							
COMPLIANCE INDEX CUT OFF LEVEL → 1 5							
MULTI HAZARD COMPLIANCE GAP MATRIX							
SEISMIC		WIND		FLOOD		FIRE	
ISSUES	seismic compliance	ISSUES	wind compliance	ISSUES	flood compliance	ISSUES	fire compliance
PLANNING							
P1	Type 1, if the fault line is <500m away from the site <u>0.15</u>	Type 5, if it is for pedestrian access only <u>0.05</u>	Type 1, if the damage potential is low <u>0.9</u>	Type 4, if the access road is suitable for motorbike only not for cars <u>0.25</u>			
P2	1	Type 4, if the probable level of wind speed reduction is < 10% <u>0.15</u>	Type 1, if the damage potential is high <u>0</u>	Type 3, if flow (Hospital's exposure to external fire) <u>0.75</u>			
P3	Type 2, Minimum effect → i.e., if some of the neighbouring buildings may collapse, however, it will have minimum impact on evacuation <u>0.75</u>	Type 2, if falling hazards can cause damage to the hospital, but will not hamper its functioning <u>0.5</u>	Type 3, if the plinth is below expected flood depth <u>0</u>	Type 2, if there is no open space but not adequate for gathering <u>0.5</u>			

H	What is the way forward
	TLM will have a computerized document on retrofitting needs of all the existing hospitals
	The same could be submitted to the local municipality for their record and evidence of safety
	TLM with this tool will be able to get a comprehensive idea on the nation wide pattern of retrofitting requirements & help them to focus on the critical infrastructure
	For accountability and accreditation, all private hospitals to submit a filled in Toolkit II showing the retrofitting need and the actions they have taken to retrofit their hospitals and facilities
	Special Note 1
	This Toolkit has considered four types of hazards. These have been adapted from different sources mentioned
	in the References. If needed, country/zone/area specific minor modifications could be made to this Toolkit
	However, such modifications should be done only at National level by experts and only if it is absolutely necessary
	Special Note 2
	This Toolkit has considered four types of hazards. However, if a country/zone/area has other types of hazards such as landslide,
	flash flood, etc., additional worksheets could be added to the existing Toolkit to increase it's robustness
	Special Note 3
	A compact Disk has been attached with this toolkit which should be used to calculate the compliance index at National Level
	after receiving the data from all the hospitals. Hard copies of only the relevant hazard checklists should be sent to the hospitals
	from this Book 2 on retrofitting hospitals for multi-hazards
	Special Note 4
	The information from the "REFERENCES/REMARKS" will be of great importance. This will not only provide hospital specific safety gaps,
	it will also bring forward nationwide pattern, if any, in the context of safety at macro level. This will help in policy reforms

CHAPTER 3

3.1 GENERAL INFORMATION: HOSPITAL

Retrofitting of Existing Hospital: Multi-Hazard Safety Assessment										Form Number #	
Organisation Identification Details							Mailing Details				
Key:			(Unique Code used in Organisation)				Plot No	Street /Road Name			
Name:											
Other Name:							Building Name				
							Mailing Address:				
							Town / City:				
							State/District				
Communication Details							Postal code:				
Telephone (Main): (____) _____											
Tel. (Toll free): (____) _____							Reading 1		Reading 2		
Fax: (____) _____					GPS (S):	_____ . _____	_____ . _____				
Email Address: _____@_____					GPS (E):	_____ . _____	_____ . _____				
Website (URL):											
Personal Contact Details of Hospital Representative							Preferred Method of Contact:				
_____	_____	_____	_____	_____	_____	_____	Tel	Cell	Fax	Email	
Title	First Name		Last Name		Designation (Job Title)						
(____) _____			(____) _____								
Telephone Number			Cell Number				Best time to contact you				
_____@_____											
Email Address											
Surveyor:					Date completed by:			Signed:			

Infrastructure Details (Services available)									
General Information									
Parking:	Yes	No							
Access Road:	Yes	No	Type:	Blacktop	Concrete	Gravel	Kutchra	any other	
	Yes	No							
No of storeys of the building									
Total building height from ground level			meters						
Electricity status:	Connected		Metered Supply		Solar		Generator	no supply	
No of basements, if any	Yes	No							
Structural system			load bearing wall	RCC frame	Steel	Shearwall system or any other			
Water supply available:	Yes	No							
Number of buildings:									
Total floor area in sqm									
Total no of occupants in the building									

PREPARE A SITE PLAN: PROPORTIONATE SKETCH: SCAN IT

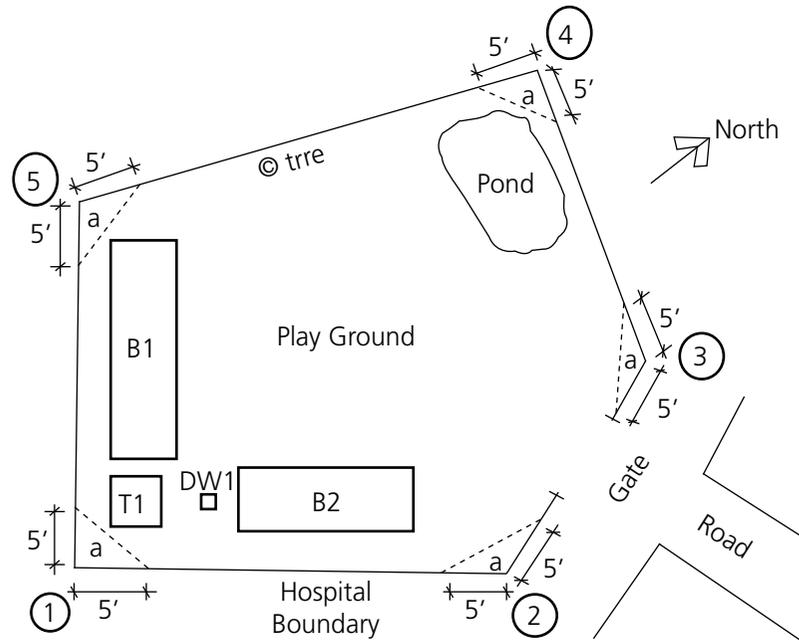
This will be done once and should be preserved.

Subsequent additions and alterations done to the campus and/or buildings will be recorded by mentioning the date.

This part may need assistance of a local level engineer/surveyor.

- Draw the campus boundary first
- Draw the open spaces and write on the paper such as play field, water body etc.
- Draw the buildings and mark them as B1, B2 etc.
- Draw the toilets T1, T2 , Drinking Water facilities DW1, DW2 and the disposal system ,
- Write the evacuation road width
- Draw the big trees/ transmission tower, if any, inside and near the compound
- For each building use the format in the following pages and carryout the defect identification and recording.
- Mark the highest observed flood water level on the wall of one of the existing buildings, if applicable

Write the plinth height from ground level - also
Write the high flood level with respect to the plinth level



EXAMPLE OF SITE PLAN

- At corner 1, 2, 3, 4 and 5 mark at 5' as shown in the above figure and the measure the distance "a1, a2, a3, a4" at all five corners.
- Measure 1-2, 2-3, 3-4, 4-5 and 5-1 in meters and write on the above drawing
- First measure the plinth height of B1 or B2 and mark on the drawing as shown. Take a level pipe and mark the high flood level of the plinth level. For example, if the high flood level is 600mm below the plinth, then write HFL (-600). In case the high flood level is 900mm above the plinth level then write HFL (+900)
- Write about existing use pattern of the adjacent plots


ASSET REGISTER: Record of the hospital facilities and their physical conditions: Use separate pages if necessary


Facilities mark as/ site plan	No of storey	Function of the facility and no of rooms	Who constructed it	Year of construction/ age	Cost of initial construction (USD)	History of building maintenance	Type of construction methods adopted in the building				Maintenance requirements of the building **	MULTI HAZARD INDEX
							Foundation	Wall	Roof	Floor finish		
B1												
B2												
...												
**												
Type 1 if the building/ facility is in good condition - no need for maintenance,							Type 4 if the building/ facility needs major repairs, roof leakage, floor/wall cracks					
Type 2 if the building/ facility is in OK condition, need for routine maintenance,							Type 5 if the building/ facility is unsafe – to be replaced- foundation unsafe					
Type 3 if the building/ facility needs minor repair, e.g., hairline cracks												




SPECIAL NOTE: FOR EVERY BUILDING SHOWN IN THE ASSET REGISTER, CARRY OUT SAFETY COMPLAINE


ASSESSMENT FOLLOWING THE "USER INSTRUCTION" AND TABULATE THE MULTI HAZARD INDEX IN COLUMN "M"




ANNEXURE I: SEISMIC SAFETY EVALUATION: FOR EASE OF FILLING ANSWERS TO KEY QUESTIONS, ONLY THE COLUMN A, B, C, D & J HAVE BEEN SHOWN HERE




READ THIS BEFORE ANSWERING THE KEY QUESTIONS				
	User will read the following key questions in this column	Against each Key Question, the User will choose the appropriate answer from the given options shown in this column	↓ User's Input 1	↓ User's input 2: Follow the instructions in column C and type in the necessary information in this column
A	B	C	D	J
EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
	PLANNING			
 <p>P1 building distance earth's surface active major fault</p>	<p>Are you aware of geological investigation report to know if there is an active major fault on or adjacent to the existing hospital site?</p> <p>Special note: Consult local building department, State geologist, local university, or local geotechnical expert.</p>	<p>If you are aware of geologic investigations write the source in column "REFERENCES/REMARKS" and then choose one from the following options</p> <p>Type "NA" if geological investigation has been referred to , which shows that the issue of fault line is not applicable in your case</p> <p>Type 0, if you haven't done or referred to geological investigations for your site</p> <p>Type 1, if the fault line is < 500m away from the site</p> <p>Type 2, if the fault line is between 500m -1000m from the site</p> <p>Type 3, if the fault line is >1000m away from the site</p>		
 <p>P2 access road ce ss</p> <p>Site plan showing access</p>	<p>An important aspect of safety of a building is the type of access road from main road to the site of the new hospital</p>	<p>Depending upon the type of access road to your site choose one from the following options;</p> <p>Type 1, if two or more roads from mainstreet to building, wide enough to allow one fire engine to reach, reverse and return to the mainroad</p> <p>Type 2, if there is one access road suitable for fire engine access & movement</p> <p>Type 3, if access road is for cars and not fire engine</p> <p>Type 4, If the access road is suitable for motorbike only and not for cars</p> <p>Type 5, if it is for pedestrian access only</p>		




EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>P3</p> <p>Collapse of buildings had blocked many access roads in the old town of Bhuj, India (earthquake, 2001). It had made rescue and relief extremely difficult</p>	<p>During earthquake, buildings along the access road to your site may collapse and block it, thus affecting post earthquake evacuation and entrance for service</p>	<p>Visit the site and visually assess the severity of impact on safe evacuation and access of services to the site immediately after an earthquake → Choose one from the following options</p> <p>Type 1, No effect→ i.e., if the existing road is wide enough and the surrounding buildings are unlikely to fall during earthquake or there is/ are alternative routes to the hospital, unlikely to be blocked by falling buildings, power lines, etc.</p> <p>Type 2, Minimum effect → i.e., if some of the neighbouring buildings may collapse, however, it will have minimum impact on evacuation</p> <p>Type 3, Medium effect→ i.e., if part collapse may take place, however, it will have medium impact on evacuation</p> <p>Type 4, Maximum effect→i.e., if possible collapse of neighbouring buildings are likely to completely block the road from evacuation</p>		
<p>P4</p> <p>Providing onsite backup for water, power gas, etc. is not adequate. They need housekeeping and periodic maintenance as well</p>	<p>Municipal utilities such as water, power, and gas, are often disrupted in strong shaking. Therefore, onsite backups should provide 48 hours of use.</p>	<p>Additional systems increase the probability of a hospital remaining functional after disaster. Choose one from the following options</p> <p>Type 1, If in-house backup sources of a)water, b)power and c)gas have been provided in the hospital for 24-48 hrs</p> <p>Type 2, If in-house backup sources of a)water and b)power or c)gas have been provided in the hospital for 24-48 hrs</p> <p>Type 3, If inhouse backup sources of only b)power or c)gas have been provided in the hospital for 24-48 hrs</p> <p>Type 4, If inhouse backup sources of only a)water have been provided in the hospital for 24-48 hrs</p> <p>Type 5, If there are no inhouse backup sources of a)water, b)power & c)gas in the hospital</p>		
<p>P5</p>  <p>Buildings too close may lead to pounding</p>	<p>If your building is in seismic Zone V,IV or III, then have you provided adequate distance from adjacent buildings or other structures from the project building to avoid pounding effect?</p>	<p>Write the distance (in meters) of the nearest building/structure from the hospital under consideration in column "REFERENCES/REMARKS"</p> <p>Type 1, if adequate gap has been provided to avoid pounding effect</p> <p>Type 0, if adequate gap not provided to avoid pounding effect</p>		



EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>P6</p>  <p>Site plan showing open space</p>	<p>Whether open space is available adjacent to the building for people to assemble during/immediately after earthquake ?</p>	<p>In the column "REFERENCES/REMARKS, write the approximate length and width of such open space and the number of people who will need it Choose one from the following options</p> <p>Type 1, if there is adequate open space for gathering</p> <p>Type 2, if there is open space, but not adequate for gathering</p> <p>Type 3, if there is no open space for available for gathering</p>		
<p>P7</p>  <p>Space for expansion</p> <p>Emergency Ward</p>	<p>Is there space available for expansion in case of emergency/mass casualty? For example emergency department near outpatient deptt. will help to expand emergency service and increase emergency capacity of the hospital.</p>	<p>Choose one from the following options</p> <p>Type 1, If there is space to expand the existing emergency unit to twice its present area</p> <p>Type 2, If there is space to expand the existing emergency unit to 1.5 times its present area</p> <p>Type 3, If there is space to expand the existing emergency unit to 1.25 times its present area</p> <p>Type 4, If there is no space to expand the existing emergency unit</p>		
ARCHITECTURAL ISSUES				
<p>A1</p>  <p>Plan forms such as T,L etc are irregular</p>	<p>Is the architectural/structural configuration irregular in plan?</p>	<p>Move in and around the building & assess the level of symmetry of the building plan and then choose one from the following that is appropriate</p> <p>Type 1, if the shapes is regular, structure has uniform plan, and there are no elements that would cause twisting of building</p> <p>Type 2, if Shape is irregular but structure is uniform</p> <p>Type 3, if Shapes are irregular and structure is not uniform</p>		
<p>A2</p>  <p>Section</p> <p>Plan</p> <p>Two portions of the same building have different masses: vertical</p>	<p>Is there vertical irregularity in architectural/structural configuration?</p>	<p>Move in and around the building & assess the level of symmetry of the building massing and then choose one from the following that is appropriate</p> <p>Type 1, if storey heights are of very similar (i.e., they differ by < 5%); there are no discontinuous or irregular elements.</p> <p>Type 2, if storey heights are similar (they differ by > 5% but <20%) and there are few discontinuous or irregular elements;</p> <p>Type 3, if storey heights differs by >20% and there are significant discontinuous or irregular elements</p>		


EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>A3</p>  <p>Ramps to be provided for people to be wheeled out quickly</p>	<p>Are there provisions for physically challenged-friendly access to the buildings and functional areas?</p>	<p>Examine the existing access routes against codes/standards, mention it in the column "REFERENCES/REMARKS →Choose one from the following options</p> <p>Type 1, if the design has provision for easy evacuation of physically challenged people</p> <p>Type 2, if the existing provision for evacuation of physically challenged people is average</p> <p>Type 3, if the design is poor for evacuation of physically challenged people</p>		
<p>A4</p>  <p>Wide corridor with signage for easy evacuation in emergency</p>	<p>Is there a provision for emergency exit in the building plan?</p>	<p>Move in and out of the building to assess if exits have been provided for easy evacuation of the occupants. Choose one option from the following</p> <p>Type 1, if one or more exit corridors of at least 2.4 meters width exists, which are well lit, easy to identify and use in emergency</p> <p>Type 2, if one or more exit corridors of width less than 2.4 m but greater than 1.2m exists, which are well lit, easy to identify and use in emergency</p> <p>Type 3, if only one corridor of less than 1.2m width exists for emergency exit</p> <p>Type 4, there is no emergency exist in design</p>		
<p>A5</p> <p>Glass must be installed in the openings with adequate space/ cushioning between glass and the lintel, jambs and sill to accommodate drift of the structural system</p>	<p>Are glass and other panels fixed in openings in a way so that they will not be affected due to drift of the main structural frame during earthquake?</p>	<p>Inspect the glass & other panels to know if they have safe detailing. Choose one from the following options</p> <p>Type NA, this is not applicable</p> <p>Type 1, if the existing detail of glass in openings is safe for drift of the structure</p> <p>Type 0, if the existing detail of glass in openings is not safe for drift of the structure</p>		
<p>A6</p> <p>If not fixed adequately, such tiles may come off during earthquake, making exit of the occupants unsafe or impossible</p>	<p>Are there tiles fixed on the walls particularly those surrounding exit staircases? If yes, then are those adequately fitted with bolts (or equivalent glue) for seismic safety?</p>	<p>Choose one from the following options</p> <p>Type NA, if this is not applicable</p> <p>Type 1, If the tiles are fixed to the walls with bolts or equivalent glue or other methods</p> <p>Type 0, If the tiles are not fixed to the walls with bolts or equivalent glue or other methods</p>		

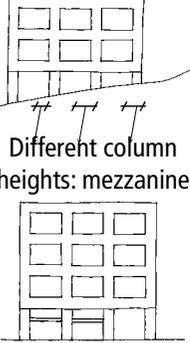
EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>A7 RCC band or equivalent as top arrester</p> 	<p>Are parapets securely attached to the building structure to stop it from falling during earthquake?</p>	<p>Unreinforced masonry parapets are especially vulnerable if the wall top is not secured</p> <p>Type NA if there is no parapet in your building</p> <p>Type 1, if the parapet wall has a RCC band on top with vertical reinforcements anchored to the slabs at regular intervals</p> <p>Type 2, if similar arrangement as RCC band exists to stop the parapet wall from falling</p> <p>Type 3, if parapets are not restrained at all</p>		
<p>A8</p> 	<p>Length/breath ratio and Height/width ratio of the building within permissible limit as per code?</p>	<p>Mention the code name in the column "REFERENCES/ REMARKS"</p> <p>Type 1, if the length/ breadth/ height ratios are within safe limit</p> <p>Type 2, if the length/ breadth/ height ratios are marginally out of safe limit</p> <p>Type 3, if Medium level of variation of length/ breadth/ height ratio from safe limit</p> <p>Type 4, if major variation from safe limit of length/ breadth/ height</p>		
<p>A9</p>  <p>Good example: Building plan shows that the columns are in grid lines in both directions</p>	<p>Are the walls and/or columns provided in grid lines in each direction of the plan?</p>	<p>Choose one from the following options</p> <p>Type 1, if all walls and/or columns are in grid in both directions</p> <p>Type 2, if all walls &/or columns are in grid in one direction & some (<15%) not in grid in other direction</p> <p>Type 3, if some walls &/or columns are in grid >15% but <25%</p> <p>Type 4, if >25% of walls and/or columns are not in grid</p>		


EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
STRUCTURAL ISSUES				
<p>S1</p> <p>In many places micro zoning maps may not be available. However, if it exists, the engineer must follow the micro zoning recommendations in design</p>	<p>Is the existing building safe according to the seismic micro zoning factors?</p>	<p>If Micro-Zonation map is available then mention the source in the column "REFERENCES/ REMARKS". If you feel that a rapid structural assessment by a specialist is needed mention in column "REFERENCES/ REMARKS".</p> <p>Type "NA" If Micro-Zonation map is not available and also write "not available" in the column "REFERENCES/ REMARKS"</p> <p>Type 1, if the existing building is safe as per the micro zonation recommendations</p> <p>Type 0, if the existing building is not safe as per the micro zonation recommendations</p>		
<p>S2</p> <p>Steel braced frame</p>  <p>Shear walled structure</p>  <p>RCC frame structure</p> 	<p>Are you aware of Geotechnical set up of the areas (soil condition) & have you chosen structural system based on soil type & seismic zone</p> <p>If your site has soft/poor soil (<10 t/sqm) →</p> <p>If your site has medium soil (10-30 t/sqm) →</p> <p>If your site has hard soil (>30t/sqm) →</p>	<p>If you have information on geological setup in which your site is located, please mention the source in the column "REFERENCES/ REMARKS";</p> <p>Type 1, If the building has a light weight rigid structural system, e.g., steel braced frame, steel tube frames, etc. on pile or similar deep foundations</p> <p>Type 2 If the building is not based on structural system according to soil condition</p> <p>Type 3, If the building has a rigid structural system with short period, e.g., shear walled, steel braced, confined masonry, etc</p> <p>Type 4, If the building is not based on structural system according to soil condition</p> <p>Type 5 If the building has a flexible system with long period, e.g., RCC frame structure, base isolation, etc</p> <p>Type 6 If the building is not based on structural system according to soil condition</p>		


EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S3</p> <p>Before earthquake: interlocking forces in soil particles</p>  <p>During earthquake: reduced interlocking forces in soil particles</p>  <p>During earthquake: when liquefaction happens</p> 	<p>Was liquefaction effect considered in the existing building design- if applicable for your site?</p> <p>Soft soil that can lead to force amplification or liquefaction</p> <p>Look at the past record, drawings of the building</p>	<p>Mention the source of information on this issue regarding your site in column "REFERENCES/ REMARKS" and choose one from the following options.</p> <p>Type NA, liquefaction issue was found not applicable</p> <p>Type 1, if liquefaction is applicable and it was considered in design</p> <p>Type 2, if liquefaction is applicable and it was not considered in design</p> <p>Type 3, if neither any source of information was referred to nor the effect of liquefaction effect in design was considered</p>		
<p>S4</p>  <p>Section shows that load path of the building is discontinuous- this is not desirable</p>	<p>Is there a continuous load path from all structural components of the building to the foundation?</p> <p>A continuous load path enables a structure to act together as a whole when shaken. Connections from walls to floors and roofs should also form part of this load path.</p>	<p>Move in and around the building and check. If you feel that a specialist's input is needed mention in column "REFERENCES/REMARKS"</p> <p>Type 1, if the load path is continuous</p> <p>Type 2, if there is a minor deviation from the load path</p> <p>Type 3, if there is a major deviation from load path</p>		


EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p style="text-align: center;">S5</p>  <p>For seismic safety, a masonry building should have;</p> <ol style="list-style-type: none"> 1. RCC bands at plinth & lintel level 2. vertical reinforcements at wall junctions & on two sides of each door/ window, 	<p>If the hospital is a Masonry Structure, were vertical reinforcements & horizontal bands provided in walls according to code?</p> <p>Unreinforced masonry has proven very vulnerable in strong shaking. To improve seismic performance of masonry buildings one needs to provide, reinforcements at all wall corners and RCC bands at plinth, window sill and lintel level</p>	<p>This is difficult to assess in an existing building. One has to refer to historical data, if available. Mention in cloumn "REFERENCES/ REMARKS" if you could not do this bit of inspection</p> <p>Type "NA", if it is not a masonry structure or if the inspection could not be done</p> <p>Type 1, if reinforcement at all wall corners and horizontal RCC bands at plinth and lintel levels have been provided</p> <p>Type 2, if only the RCC bands have been provided</p> <p>Type 3, if only corner reinforcments have been provided</p> <p>Type 4, If no horizontal band and vertical reinforcements provided</p>		
<p style="text-align: center;">S6</p>  <p>Ductile detail enables a structure to undergo large deformation before failure. It gives adequate warning to the occupants before failure</p>	<p>Was the reinforcement detailing done as per code to ensure ductility of the structure?</p>	<p>This is difficult to assess in an existing building. One has to refer to historical data, if available. Mention in cloumn "REFERENCES/ REMARKS" if you could not do this bit of inspection</p> <p>Type "NA", if not applicable or the inspection could not be done</p> <p>Type 1, of ductile detailing has been adopted as per codes</p> <p>Type 2, if ductile detailing is partially done</p> <p>Type 3, if ductile detailing has not been done as per code</p>		



EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S7</p> <p>It is mandatory to consider seismic force on a building if it is in earthquake prone area.</p>	<p>Was seismic load considered in the building design?</p>	<p>This is difficult to assess in an existing building. One has to refer to historical data, if available. Mention in column "REFERENCES/ REMARKS" if you could not do this bit of inspection</p> <p>Type NA if you could not ascertain this</p> <p>Type 1, If seismic load has been considered in design</p> <p>Type 0, If seismic load has not been considered in design</p>		
<p>S8</p> <p>H>=40m Zone IV/V</p> 	<p>The code (e.g. IS 1893, 2002) has recommended dynamic analysis for buildings of certain heights, vertical and plan symmetries and seismic zones. Read the following and identify the combination of symmetry, height and seismic zone your building belongs to ↓</p>	<p>Answer only the option that is applicable for your hospital</p> <p>If you could not carry out this inspection and feel that a specialist's input is needed, mention it in column "REFERENCES/REMARKS"</p>		
<p>H>=90m Zone II/III</p> 	<p>Category 1: if row E57= 1, & E61=1, i.e., building is symmetric and it's height >= 40 meters and the site is in seismic zone IV or V →</p> <p>Category 2: if row E57= 1, & E61=1, i.e., building is symmetric and it's height >=90 meters and the site is in seismic zone II or III →</p>	<p>Type 1, if you have done dynamic analysis of seismic force</p> <p>Type 2, if dynamic analysis of seismic force was not carried out or inspection could not be done</p> <p>Type 3, if you have done dynamic analysis of seismic force</p> <p>Type 4, if dynamic analysis of seismic force was not carried out or inspection could not be done</p>		
<p>H>=12m Zone IV/V</p> 	<p>Category 3: if row E57 or E61 <1, i.e., building is asymmetric and it's height >=12 meters and the site is in seismic zone IV or V →</p> <p>Category 4: if row E57 or E61 <1, i.e., building is asymmetric and it's height >= 40 meters and the site is in seismic zone II or III →</p>	<p>Type 5, if you have done dynamic analysis of seismic force</p> <p>Type 6, if dynamic analysis of seismic force was not carried out or inspection could not be done</p> <p>Type 7, if you have done dynamic analysis of seismic force</p> <p>Type 8, if dynamic analysis of seismic force was not carried out or inspection could not be done</p>		
<p>H>=40m Zone II/III</p> 	<p>Category 5: None of the categories 1 to 4</p>	<p>Type 9, If your building does not fall under anyone of the categories</p>		

EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S9 Mechanical equipment/ batteries can have considerable self weight and will transfer a part of their loads to the structure during earthquake- this must be considered in design</p>	<p>Has load of mechanical equipments, batteries been considered in design?</p>	<p>Choose one from the following options Type "NA" if not applicable Type 1, if load of mechanical equipment, batteries have been considered in design Type 0, If load of mechanical equipment, batteries have not been considered in design</p>		
<p>S10 Different column heights: building on slope</p>  <p>Different column heights: mezzanine</p>	<p>Was Short column effect been considered in structural analysis and design?</p> <p>Special note: short columns attract more seismic load than tall columns. In framed structure, short column effect may be highly detrimental and hence, such effect must be considered in design</p>	<p>This is difficult to assess in an existing building. One has to refer to historical data, if available. Mention in cloumn "REFERENCES/ REMARKS" if you could not do this bit of inspection Type "NA" , if not applicable or the inspection could not be done Type 1, if short column effect considered in the structure? Type 0, if short column effect not considered in the structure?</p>		


EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S11</p>  <p>In masonry buildings, these should be at least</p>	For Masonry buildings, the locations of doors & windows are very important. Check if they are as per safety	Each door or window should be at least 600mm away from wall corners. The space between two openings should also be at least 600mm. Choose one from the following options		
	If not followed, there could be severe damage to the building	Type "NA", if not a masonry building Type 1, if doors, windows are at least 600mm away from wall corner and there is at least 600mm wide wall between two openings Type 0, if doors, windows are not 600mm away from wall corner and/or there is < 600mm wide wall between two openings		
<p>S12</p>  <p>$W1+W2 \leq 0.5L$</p>	Check if the total width of doors and windows in a wall is \geq half the total wall length	Add the door and window widths on a wall and check if it is $>$ the wall length. Choose one from the following		
	If this is not followed, there will be possibility of sliding of the portion of the wall above window sill	Type "NA", if not a masonry building Type 1, If total door+window width in a wall is $<$ its wall length & this is true for all walls of the building Type 0, If total door+window width in a wall is $>$ its wall length		
NON STRUCTURAL ISSUES				
<p>NS1</p>  <p>Needs flexible connection to accommodate seismic movement and to avoid joint failure</p>	Are AC ducts, AC piping provided with flexible connections?	Choose one from the following options		
	Differential movement between sections of the building can cause breakage and leaks in pipe and duct joints if no provision is made for movement.	Type "NA" if there is no Airconditioning system in the hospital Type 1, if both AC ducts and AC piping have been provided with flexible connections Type 2, if either AC ducts or AC piping is provided with flexible connections Type 3, if neither AC ducts or AC piping is provided with flexible connections		
<p>NS2</p> <p>During earthquake plumbing lines may break and roof top water tanks may topple leaving no water for drinking</p>	Are plumbing lines, rooftop/overhead water tank safely placed and anchored adequately	If there is no water supply then mention it in column "REFERENCES/REMARKS" Type 1, if plumbing lines & rooftop/overhead water tank are adequately supported & secured or there is a hand pump Type 0, if plumbing lines & rooftop/overhead water tank are not supported & secured or there is no water supply	1	





EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS3</p> <p>During earthquake fire protection lines may break leaving no water for fire fighting</p>	Is fire protection piping correctly installed and braced?	<p>If fire protection piping does not exist, mention this in the column "REFERENCES/REMARKS". Choose one from the following options</p> <p>Type "NA", if fire protection piping does not exist</p> <p>Type 1, if fire protection piping correctly installed and braced</p> <p>Type 0, if fire protection piping not correctly installed and braced</p>		
<p>NS4</p> 	Are gas lines to laboratories provided with flexible connection? Otherwise they can cause dangerous leaks & may cause fire	<p>If there is no lab in the hospital, mention this in the column "REFERENCES/REMARKS" → Choose one from the following options</p> <p>Type "NA", if there is no lab.</p> <p>Type 1, if you have provided flexible joints and the lines are clamped at suitable points</p> <p>Type 0, if you have not provided flexible joints and the lines clamped at suitable points</p>		
<p>NS5</p> <p>This could be a falling hazard</p>	Are suspended lighting fixtures securely attached, braced, or designed to stop sideways movement?	<p>Choose one from the following options. If suspended lighting fixtures do not exist, mention this in the column "REFERENCES/REMARKS"</p> <p>Type "NA", if suspended lighting fixtures do not exist</p> <p>Type 1, if suspended lighting fixtures are securely attached and braced</p> <p>Type 0, if suspended lighting fixtures are not securely attached and braced</p>		
<p>NS6</p> <p>Make sure that that they do not topple or slide</p>	Are boilers and other tanks securely braced?	<p>Have you addressed this issue? If there is no Boiler, Mention this in the column "REFERENCES/REMARKS"</p> <p>Type "NA", if the building does not have a Boiler</p> <p>Type 1, if boilers and other tanks securely braced</p> <p>Type 0, boilers and other tanks not securely braced</p>		
<p>NS7</p> <p>The generator, batteries, and other electrical equipment are necessary for emergency operation.</p>	Is generator and associated equipment secured against movement?	<p>Have these been secured against movement? If emergency generator does not exist, mention this in the column "REFERENCES/REMARKS"</p> <p>Type "NA", if emergency generator does not exist</p> <p>Type 1, if emergency generator etc. are secured against movement</p> <p>Type 0, if emergency generator etc. are not secured against movement</p>		
<p>NS8</p> <p>Switch gear and transformers are heavy and sliding or movement failure can shutdown the electrical system.</p>	Is heavy electrical equipment adequately secured?	<p>Have you addressed this issue? If heavy electrical equipment does not exist, Mention this in the column "REFERENCES/REMARKS";</p> <p>Type "NA", if heavy electrical equipment does not exist</p> <p>Type 1, if heavy electrical equipment is adequately secured</p> <p>Type 0, if heavy electrical equipment is not secured</p>		



EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS9</p>  <p>Heavy equipment may slide and break utility connections.</p>	<p>Is heavy mechanical equipment adequately secured (anchored)? Heavy equipment may slide and break utility connections.</p>	<p>Are they adequately secured by appropriate anchorage? If there is no such equipment, mention this in the column "REFERENCES/REMARKS" → choose one from the following</p> <p>Type "NA", if your building does not have such equipment</p> <p>Type 1, if heavy mechanical equipment is adequately secured</p> <p>Type 0, if if heavy mechanical equipment not secured</p>		
<p>NS10</p> <p>The architect should co-ordinate with the lift supplier to address this issue</p>	<p>Are the elevator cars, counterweights, and equipment anchored for seismic forces?</p>	<p>Mention it in the column "REFERENCES/REMARKS, if the hospital does not elevators</p> <p>Choose one from the following options</p> <p>Type "NA", if elevators do not exist</p> <p>Type 1, if the elevator cars, counterweights, and equipment are anchored for seismic forces</p> <p>Type 0, if the elevator cars, counterweights, and equipment are not anchored for seismic forces</p>		
<p>NS11</p> <p>Elevator needs power to enable vertical patient movement.</p>	<p>Is at least one elevator in each wing connected to the emergency power system?</p>	<p>Have you provided it? If elevators do not exist, mention this in the column "REFERENCES/REMARKS"</p> <p>Type "NA", elevators do not exist</p> <p>Type 1, if at least one elevator in each wing is connected to the emergency power system</p> <p>Type 0, if none of the elevators are connected to the emergency power system</p>		
<p>NS12</p> <p>Make sure that the anchorage, bracing and connections are adequate against horizontal force</p>	<p>Are the bulk Oxygen tank and associated equipment secured? Especially the legs, anchorage, and foundations of large tanks</p>	<p>If the hospital does not have Oxygen tank, mention it in the column "REFERENCES/REMARKS" →Choose one from the following options</p> <p>Type "NA", if bulk oxygen tank does not exist in the hospital</p> <p>Type 1, if the bulk oxygen tank and associated equipment are secured</p> <p>Type 0, if the bulk oxygen tank and associated equipment are not secured</p>		
<p>NS13</p> <p>Strap them with the wall at base. mid height and top</p>	<p>Is Nitrogen storage secured? Loose tanks may fall and break connections.</p>	<p>If the hospital does not have Nitrogen Storage, mention it in the column "REFERENCES/REMARKS" →Choose one from the following options</p> <p>Type "NA", if Bulk Nitrogen Store does not exist</p> <p>Type 1, if nitrogen storage is secured</p> <p>Type 0, if nitrogen storage is not secured</p>		

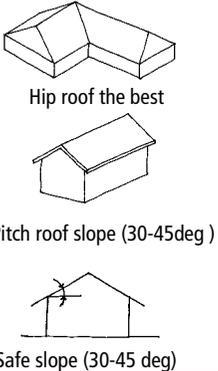
EXPLANATORY SKETCH	KEY QUESTIONS ON SEISMIC-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + OPTIONS FOR ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS14</p>  <p>Make sure that the anchorage, bracing and connections are adequate against horizontal force</p>	<p>Is fire alarm equipment secured against movement? Equipment can slide or topple, breaking connections.</p>	<p>if there is no fire alarm equipment in the hospital, mention this in the column "REFERENCES/REMARKS" →Choose one from the following options</p> <p>Type "NA", if there is no fire alarm equipment</p> <p>Type 1, if fire alarm equipment is secured against movement</p> <p>Type 0, if fire alarm equipment not secured against movement</p>		
<p>NS15</p>  <p>Communication antenna: make sure that the anchorage, bracing and connections are adequate against horizontal force</p>	<p>Are communications components, including antennas, adequately braced and supported?</p>	<p>if there is no such equipment in the hospital, mention this in the column "REFERENCES/REMARKS" →Choose one from the following options</p> <p>Type "NA", if there is no such equipment</p> <p>Type 1, if communications components, including antennas are adequately braced and supported</p> <p>Type 0, if communications components, including antennas are not braced and supported</p>		
<p>NS16</p>  <p>An example of base isolator</p>	<p>Is there base isolation for generator?</p>	<p>if there is no generator in the hospital, mention this in the column "REFERENCES/REMARKS" →Choose one from the following options</p> <p>Type "NA", if there is no generator.</p> <p>Type 1, if base isolation has been done for generator</p> <p>Type 0, if base isolation has not been done for generator</p>		


ANNEXURE II: WIND SAFETY EVALUATION: FOR EASE OF FILLING ANSWERS TO KEY QUESTIONS, ONLY THE COLUMN A, B, C, D & J HAVE BEEN SHOWN HERE



READ THIS BEFORE ANSWERING THE KEY QUESTIONS				
	User will read the following key questions in this column	Against each Key Question, the User will choose the appropriate answer from the given options shown in this column	 User's Input 1	User's input 2: Follow the instructions in column C and type in the necessary information in this column
A	B	C	D	J
EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
	PLANNING			
<p style="text-align: center;">P1</p>  <p style="text-align: center;">Site plan showing access roads</p>	<p>An important aspect of safety of a building is the type of access road from the main road to the site of the new hospital</p>	<p>Depending upon the type of access road to your site, choose one from the following options;</p> <p>Type 1, if two or more roads from mainstreet to building, wide enough to allow one fire engine to reach, reverse and return to the mainroad</p> <p>Type 2, if there is one access road of the above type</p> <p>Type 3, if access road is for cars and not fire engine</p> <p>Type 4, If the access road is suitable for motorbike only and not for cars</p> <p>Type 5, if it is for pedestrian access only</p>		
<p style="text-align: center;">P2</p>  <p style="text-align: center;">The mound reduces wind load on the building from the sea side</p>	<p>Will the surrounding landscape and topography reduce wind speed on your building?</p>	<p>Based on historical data and community experience judge this issue. Mention the source of information in column "REFERENCES/REMARKS", if referred to</p> <p>Type 1 , if the probable level of wind speed reduction is > 50%</p> <p>Type 2 , if the probable level of wind speed reduction is > 25% but <50%</p> <p>Type 3 , if the probable level of wind speed reduction is > 10% but <25%</p> <p>Type 4 , if the probable level of wind speed reduction is < 10%</p>		


EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>P3</p>  <p>Tower too close to the building</p>	<p>Are there trees and/or towers too close to the building that may fall on it during high wind/cyclone?</p>	<p>Depending upon the type of falling hazards at your site, choose one from the following options</p> <p>Type 1, if falling hazards can stop the hospital from functioning</p> <p>Type 2, if falling hazards can cause damage to the hospital, but will not hamper its functioning</p> <p>Type 3, if there is no threat of falling of trees/towers, etc</p>		
<p>P4</p>  <p>Plan showing wind tunnel effect on building</p>	<p>Is there a potential wind tunnelling effect at site due to the surrounding topography and/or adjacent buildings and structures</p>	<p>Choose one from the following options</p> <p>Type NA, if wind tunnelling effect does not exist</p> <p>Type 1, if wind tunnelling effect exists and you have considered it in design</p> <p>Type 0, if wind tunnelling effect exists but you did/ could not consider it in design</p>		
ARCHITECTURAL ISSUES				
<p>A1</p>  <p>Plan forms such as T,L etc are irregular</p>	<p>Is the architectural/structural configuration irregular in plan?</p>	<p>Move in and around the building & assess the level of symmetry of the building plan and then choose one from the following that is appropriate</p> <p>Type 1, if Shapes are regular, structure has uniform plan, and there are no elements that would cause torsion</p> <p>Type 2, if Shapes are irregular but structure is uniform;</p> <p>Type 3, if Shapes are irregular and structure is not uniform</p>		
<p>A2</p>  <p>Two portions of the same building have different masses: vertical irregularity</p>	<p>Is there vertical irregularity in architectural/ structural configuration?</p>	<p>Move in and around the building & assess the level of symmetry of the building massing and then choose one from the following that is appropriate</p> <p>Type 1, if storey heights are of very similar (i.e., they differ by < 5%); there are no discontinuous or irregular elements.</p> <p>Type 2, if storey heights are similar (they differ by > 5% but <20%) and there are few discontinuous or irregular elements;</p> <p>Type 3, if storey heights differs by >20% and there are significant discontinuous or irregular elements</p>		


EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>A3</p>  <p>Uniform shapes presenting minimum obstruction to the wind</p>	<p>Does the building have a uniform shape presenting minimum obstruction to the wind</p>	<p>How does your building feature in this context? Choose one from the following options</p> <p>Type 1, if regular in plan and masing</p> <p>Type 2, if regular in plan and irregular in massing</p> <p>Type 3, if both plan and massing are irregular</p>		
<p>A4</p> <p>If you know the geo-climatic conditions of the site based on historical data, it is best to orient the building to face the least wind force.</p>	<p>Is the building suitably oriented considering the prevailing wind direction</p>	<p>In terms of orientation of building what is your assessment on probable building performance against wind forces</p> <p>Type 1, if good (building suitably oriented considering the prevailing wind direction)</p> <p>Type 2, if medium (building more or less suitably oriented considering the prevailing wind direction)</p> <p>Type 3, if low (building not really oriented considering the prevailing wind direction)</p> <p>Type 4, if very low (building not oriented considering the prevailing wind direction)</p>		
<p>A5</p> <p>It is important to have latches located for easy manoeuvring during high wind</p>	<p>Do the door and windows have a good and accessible latch?</p>	<p>Choose one from the following options</p> <p>Type 1, if both doors and windows have accessible and good latches</p> <p>Type 2, if some of the doors & windows have accessible and good latches</p> <p>Type 3 if niether doors or windows have accessible and good latches</p>		
<p>A6</p>  <p>Plan showing balanced opening on opposite walls</p>	<p>Is there a balance of the size of openings on opposite walls</p>	<p>Choose one from the following options</p> <p>Type 1, if good balance of the size of openings on opposite walls</p> <p>Type 2, if medium balance of the size of openings on opposite walls</p> <p>Type 3, if low balance of the size of openings on opposite walls</p> <p>Type 4, if very low balance of the size of openings on opposite walls</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>A7</p> 	<p>Have you used a pitch or hip roof?</p> <p>Roof pitch between 30-45 deg to minimize suction caused by negative pressure</p>	<p>Hip roofs have the best record of resistance, the next best is gable roof with a pitch of 30-450 , low gable roof and flat roof have the worst record</p> <p>Type NA, if not applicable</p> <p>Type 1, if you have used a hip roof of slope > 20deg</p> <p>Type 2, if you have used a pitch roof and the slope is 30-450</p> <p>Type 3, if you have used a pitch roof and the slope is 20-290</p> <p>Type 4, if you have used a pitch roof and the slope is <190</p>		
<p>A8</p> <p>Ideally the entire building should be safe from missiles/debris. If not, then a few enclosures should be designed as shelter for the occupants during cyclone/high wind</p>	<p>In places where missile/debris are highly likely to pound on a building, then have you built an enclosure to provide debris protection?</p>	<p>This is difficult to asses. The surveyor has to go by visual judgement in this regard and also, if possible, refer to historical data</p> <p>Type "NA" if missile/debris are not likely to pound on the building</p> <p>Type 1 , if missile/debris are highly likely to pound on a building, iand there is an enclosure to provide debris protection?</p> <p>Type 0 , if missile/debris are highly likely to pound on a building, and there is no enclosure to provide debris protection?</p>		
<p>A9</p> <p>Suitable detail should be made to make sure that the storm shutter does not hamper easy handling of the glass shutters in normal</p>	<p>In case there is a possibility of occurrence of missile, have you provided storm shutters to protect the glass panes of the windows and openings?</p>	<p>Choose one from the following options</p> <p>Type "NA" if not applicable in your case</p> <p>Type 1, if building is in missile prone area and you have provided storm shutters</p> <p>Type 0, if building is in missile prone area and you have not provided storm shutters</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
STRUCTURAL ISSUES				
S1 The engineer should take account of the local conditions such as wind tunneling effect, obstructions reducing wind speed, etc.	Was the design wind speed considered at the site along with a) building height, b)width, c) height and d) topographic features? (e.g., IS 875 Part 3, 1987: Vz design wind speed, k1 risk co-efficient ,k2 terrain, height & size factor & k3 topography factor)	If there is no information on design, mention in column "REFERENCES/REMARKS" . If in high wind zone (e.g., coastal area) recommend specialists' assessment in column "REFERENCES/REMARKS" . Type 1, if design wind speed was considered along with a)building height, b)width, and c)risk, terrain and topographic features Type 0, if design wind speed was not considered along with a)building height, b)width, and c)risk, terrain and topographic features		
S2 Engineers should be careful about the presence of such walls since one might overlook this important issue in the complex process of analysis of the main structural system	Are there interior non-load-bearing walls? Unreinforced brick, concrete, and other types of masonry walls are vulnerable in wind load	If there is no information on design, mention in column "REFERENCES/REMARKS" . If in high wind zone (e.g., coastal area) recommend specialists' assessment in column "REFERENCES/REMARKS" . Type "NA" if not applicable in your case Type 1, if interior non-load-bearing walls have been designed for wind Type 0, if interior non-load-bearing walls have not been designed for wind		
S3  ABC (anchorage, bracing and connection)- three prerequisites for wind safety	Have you considered A, B & C (anchorage, bracing, connection) of safety in your design? Make sure of strong fixings and joints between all elements: foundations- walls-cladding walls-roof frame-coverings. cross bracing, anchor, connections. reinforce vertical and horizontal diagonal bracing (triangulation)	If there is no information on design, mention in column "REFERENCES/REMARKS" . If in high wind zone (e.g., coastal area) recommend specialists' assessment in column "REFERENCES/REMARKS" . Type 1, if all A,B,C were considered in design detailing Type 2, if two out of A,B,C were considered in design detailing Type 3, if only one out of A,B,C has been considered in design detailing Type 4, if none of A, B, C were considered in design detailing		
S4 Wind-borne debris can cause injury to the people during high wind.	Is there a covered walkway for building to building connection? Wind-borne debris can cause injury to the people during high wind.	Choose one from the following options based on visual inspection Type 1, if there is a covered walkway which is designed for debris Type 2, if there is a covered walkway which has not been designed for debris Type 3, if there is no covered walkway		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S5</p> <p>For large span structures such as gymnasium, auditorium, etc., one should consider the wind uplift forces in design and detailing</p>	<p>Do portions of the existing facility have long-span roof structures (e.g., a gymnasium)?</p>	<p>If there is no information on design, mention in column "REFERENCES/REMARKS". If in high wind zone (e.g., coastal area) recommend specialists' assessment in column "REFERENCES/REMARKS".</p> <p>Type "NA" if not applicable in your case</p> <p>Type 1, if large span exists and designed for structural strength for wind uplift resistance</p> <p>Type 0, if large span exists and not designed for structural strength for wind uplift resistance</p>		
<p>S6</p>  <p>If the overhang is >450mm one needs to design for wind uplift</p>	<p>Are there existing roof overhangs that cantilever more than 450mm?</p>	<p>Overhangs on buildings often have inadequate uplift resistance.</p> <p>Type NA, If not applicable</p> <p>Type 1, If it is applicable in your case and if safe in wind uplift</p> <p>Type 0, If it is applicable in your case and if not safe in wind uplift</p>		
<p>S7</p>  <p>Section shows that load path of the building is discontinuous- this is not desirable</p>	<p>Is there a continuous load path from all components of the building to the foundation?</p> <p>A continuous load path enables a structure to act together as a whole when subjected to dynamic force. Connections from walls to floors and roofs should also form part of this load path.</p>	<p>Go in & around the building & check & choose one from the following options. If in high wind zone (e.g., coastal area) may recommend specialist's intervention (mention in column "REFERENCES/REMARKS")</p> <p>Type 1, if the load path is continuous</p> <p>Type 2, if there is a minor deviation from the load path</p> <p>Type 3, if there is a major deviation from the load path</p>		
<p>S8</p> <p>The critical areas are the J bolt connections at the ridge line, hip lines, etc</p>	<p>Is it made sure that the roof covering elements such as tiles, corrugated galvanized iron sheets, etc., cannot be lifted off by wind</p>	<p>Choose one from the following options</p> <p>If not applicable type in "NA"</p> <p>Type 1, designed & detailed roof covering is safe against wind uplift</p> <p>Type 0, not designed & detailed roof covering is safe against wind uplift</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S9</p> <p>Choice of materials and detailing are crucial</p>	<p>Are existing exterior walls resistant to wind-borne debris?</p>	<p>If the building is in a cyclone/high wind-prone region, consider enhancing debris resistance, particularly in detailing. Carryout a visual inspection</p> <p>If not applicable type in "NA"</p> <p>Type 1, if designed and detailed to make the existing exterior walls resistant to wind-borne debris</p> <p>Type 0, if not designed and detailed to make the existing exterior walls resistant to wind-borne debris</p>		
<p>S10</p>  <p>Ductile detail enables a structure to undergo large deformation before failure. It gives adequate warning to the occupants before failure</p>	<p>Was the reinforcement detailing as per code to ensure ductility the structure?</p>	<p>assessment in this regard is not possible unless there is available design and drawing. Whether available or not mention this in the column "REFERENCES/ REMARKS"</p> <p>Type 1, of all reinforcements are designed & detailed for ductility as per codes</p> <p>Type 2, reinforcements are not designed & detailed for ductility as per codes</p> <p>Type 3, no information is available in this regard</p>		
NON STRUCTURAL ISSUES				
<p>NS1</p> <p>Material specification and detailing are crucial</p>	<p>Are the hinges, wind stays, latches, handles and bolts designed to ensure easy and low maintenance intensive openings that can be closed quickly</p>	<p>Choose one from the following options</p> <p>Type 1, if the design and detailing of hinges, wind stays, latches, handles and bolts of openings suitable for high wind</p> <p>Type 0, if the design and detailing of hinges, wind stays, latches, handles and bolts of openings not suitable for high wind</p>		
<p>NS2</p> <p>Material specification and detailing are crucial</p>	<p>Were the exterior doors, windows, and skylights designed and detailed for high wind?</p>	<p>Are the selected materials and systems, and detailing suitable to resist wind and wind-driven rain</p> <p>Type NA if not applicable</p> <p>Type 1, if selected materials and systems, and detailing suitable to resist wind and wind-driven rain</p> <p>Type 0, if selected materials and systems, and detailing not suitable to resist wind and wind-driven rain</p>		
<p>NS3</p> <p>Roof sheets, tiles, coconut, flower pots, garbage bins, small stones, etc., could act as missiles</p>	<p>Damage to windows, doors and other openings are commonly caused by missiles (roof sheets, tiles, coconut, flower pots, garbage bins, small stones, etc). If the building is in such zone, were this considered design?</p>	<p>Have you selected materials and systems, and detailed to resist missiles/debris?</p> <p>If not applicable type in "NA"</p> <p>Type 1, if designed and detailed doors & windows for missile</p> <p>Type 0, if not designed and detailed doors & windows for missile</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS4</p> <p>It is very important that you also consider the effect of thermal expansion and contraction related deterioration of the connection?</p>	<p>Are there tiles, veneer or stucco as exterior claddings? If applicable then are the attachments safe against wind?</p>	<p>Choose one from the following options</p> <p>If not applicable --> "NA"</p> <p>Type 1, if the effect of high wind considered while selecting materials and detailing the joint</p> <p>Type 0, if the effect of high wind not considered while selecting materials and detailing the joint</p>		
<p>NS5</p> <p>If not held down adequately, tiles may be blown off by high wind</p>	<p>Does the roof have surfacing with tiles, or insulation boards? Are the tiles safe in high wind?</p>	<p>If applicable, is it safe in the wind blow off effect?</p> <p>If not applicable --> "NA"</p> <p>Type 1, if surface tiles, or insulation boards safe in the wind blow off effect</p> <p>Type 0, if surface tiles, or insulation boards not safe in the wind blow off effect</p>		
<p>NS6</p>  <p>Consider wind blow off effect while designing the flashing or coping</p>	<p>Does the existing roof have edge flashing or coping? Is it safe in high wind?</p>	<p>If applicable, are the design and detailing safe in wind blow off effect?</p> <p>Type "NA", If not applicable</p> <p>Type 1, if safe in wind blow off effect in design and detailing of edge flashing or coping of existing roof</p> <p>Type 0, if not safe in wind blow off effect in design and detailing of edge flashing or coping of existing roof</p>		
<p>NS7</p> <p>Heavy equipment may slide and break utility connections in high wind/cyclone</p>	<p>If there are mechanical equipment mounted outside at ground or on the roof, then are they anchored to resist wind loads?</p>	<p>Choose one from the following options</p> <p>Type "NA", If not applicable</p> <p>Type 1, if there are mechanical equipment mounted outside and are anchored adequately</p> <p>Type 0, if there are mechanical equipment mounted outside and are not anchored</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON WIND-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS8 Architect should use time-tested systems</p>	<p>Are there penetrations through the roof or walls? If yes then have you designed the intakes and exhausts to avoid water leakage?</p>	<p>Choose one from the following options Type "NA", If not applicable Type 1, if adequate detailing has been done to stop water penetration through intakes/exhaust Type 0, if existing detailing does not stop water penetration through intakes/exhaust</p>		
<p>NS9</p>  <p>Communication antenna: make sure that the anchorage, bracing and connections are adequate against horizontal force</p>	<p>Are there antennae (communication masts) or satellite dishes anchored with structural part?</p>	<p>If yes, then are the design of the installations, ties, etc. safe for wind resistance? Type "NA", If not applicable Type 1, if the antennae (communication masts) or satellite dishes, ties, etc. safe for wind resistance Type 0, if the antennae (communication masts) or satellite dishes, ties, etc. not safe for wind resistance</p>		
<p>NS10 Roof sheets, tiles, coconut, flower pots, garbage bins, small stones, etc., could act as debris</p>	<p>Is the emergency generator(s) housed in a wind- and debris-resistant enclosure?</p>	<p>If applicable have you built an enclosure to provide debris protection? Type "NA", If not applicable Type 1, if you have built an enclosure to provide debris protection for the emergency generators Type 0, if you have not built an enclosure to provide debris protection for the emergency generators</p>		

ANNEXURE III: FLOOD SAFETY EVALUATION: FOR EASE OF FILLING ANSWERS TO KEY QUESTIONS, ONLY THE COLUMN A,B,C,D & J HAVE BEEN SHOWN HERE

READ THIS BEFORE ANSWERING THE KEY QUESTIONS				
	User will read the following key questions in this column	Against each Key Question, the User will choose the appropriate answer from the given options shown in this column	User's Input 1	User's input 2: Follow the instructions in column C and type in the necessary information in this column
A	B	C	D	J
EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FLOOD-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
	PLANNING			
P1 In coastal communities, even sites at some distance inland from the shoreline may be exposed to extreme storm surge flooding.	Is the site located in a storm surge inundation zone (or tsunami inundation area)? In coastal communities, even sites at some distance inland from the shoreline may be exposed to extreme storm surge flooding. If yes, then, make an assessment on damage potential due to storm surge based on historical data- consult the meteorology departments	Storm surge maps may be available at State or local emergency management offices. Mention in the column "REFERENCES/ REMARKS" whether it is available or not available		
		Type "NA" , If you have referred to the map and found your site not in such zone		
		Type 1, if the damage potential is low		
		Type 2, if the damage potential is medium		
P2 Consult local people for historical data- also consult the state geology department	Is the site located in a zone with possible water surge from glacial lake/lake caused by land slide or due to earthquake	Mention the source in column "REFERENCES/ REMARKS" if you have referred to any document or department Choose one from the following options		
		Type "NA" if not applicable		
		Type 1, if the damage potential is high		
		Type 0, if the damage potential is very low		
P3 Refer to historical data for a safe decision	What is the expected level of inundation at the site? i.e., expected maximum flood elevations with respect to the plinth level of the building, e.g., the score will be high if the maximum flood elevation is 300mm below the plinth level.	Mention the max. flood level (+/-) in mm with respect to the plinth level in the column "REFERENCES/ REMARKS" → Choose one from the following options		
		Type 1, if the plinth is atleast 300mm above the maximum inundation level		
		Type 2, if the plinth is atleast 150mm above the maximum inundation level		
		Type 3, if the plinth is below expected flood depth		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FLOOD-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>P4</p> <p>Duration has bearing on the stability of earthen fills, access to a site and emergency response and durability of materials that come into contact with water. Records of actual flooding are the best indicator of duration as most floodplain analyses do not examine duration.</p>	<p>What is the potential damage level due to the expected duration of flooding?</p>	Mention the duration of flooding in column "REFERENCES/REMARKS" → what is the damage potential due to stagnation of flood water		
		If not applicable --> "NA"		
		Type 1, if damage potential is low in expected duration of flooding		
		Type 2, if damage potential is medium in expected duration of flooding		
		Type 3, if damage potential is high in expected duration of flooding		
<p>P5</p> <p>Although dam failure generally is considered an unlikely event, the potential threat should be evaluated due to the catastrophic consequences.</p>	<p>Is the site in an area predicted to be inundated if an upstream dam were to fail?</p>	Choose one from the following options		
		If not applicable --> "NA"		
		Type 1, if potential threat of upstream dam failure is very low		
		Type 2, if potential threat of upstream dam failure is medium		
		Type 3, if potential threat of upstream dam failure is high		
<p>P6</p> <p>If areas with poor local drainage and frequent flooding cannot be avoided, filling, regrading, and installation of storm drainage facilities may be required.</p>	<p>Does the surrounding topography contribute to flooding at the site? Is there a history of local surface drainage problems due to inadequate site drainage?</p>	Mention in the column "REFERENCES/REMARKS" if such incidences have happened in the past also mention the severity of such flooding		
		If not applicable --> "NA"		
		Type 1, if low chance of surrounding topography contributing to flooding		
		Type 2, if medium chance of surrounding topography contributing to flooding		
		Type 3, if high chance of surrounding topography contributing to flooding		
<p>P7</p> <p>Access is increasingly important as the duration of flooding increases. For the safety of occupants, most critical facilities should not be occupied during flood events.</p>	<p>Is at least one access road to the site/ building passable during flood events?</p>	choose one from the following options		
		Type 1, if at least one access road to the site/building is passable during flood events		
		Type 0, if no access road to the site/building is passable during flood events		
<p>P8</p> <p>Areas where vehicles could be affected should have signage to warn users of the risk. Emergency response plans should include notification of car owners.</p>	<p>Are ground level parking lots located in flood-prone areas?</p>	How susceptible is it to flooding?		
		Type NA, if not applicable		
		Type 1, if flooding of ground level parking lot's susceptibility is low		
		Type 2, if flooding of ground level parking lot's susceptibility is medium		
		Type 3, if flooding of ground level parking lot's susceptibility is high		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FLOOD-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
	ARCHITECTURAL ISSUES			
A1 New critical facilities built in flood hazard areas should not have any functions occupying flood-prone spaces (other than parking, building access, and limited storage)	Are any critical building functions occupying space that is below the elevation of the past record of flood or the Design Flood Elevation?	Choose one from the following options		
		Type NA, If not applicable		
		Type 1, if critical functions could be relocated to upper levels that are above predicted flood elevations		
		Type 2, if critical functions cannot be relocated, but flood proofing could be done		
A2 These issues should be addressed right at the schematic design level by the architect	If critical functions must continue during a flood event, have power, supplies, and access issues been addressed?	Choose one from the following options		
		Type NA, If not applicable		
		Type 1, completely addressed (critical functions can continue during a flood event with power, supplies, and access)		
		Type 2, partly addressed (critical functions can partially continue during a flood event with power, supplies, and access)		
A3 If critical contents cannot be permanently located on higher floors, a flood response plan should take into account the time and attention needed to move such contents safely.	Have critical contents (files, computers, servers, equipment, research, and data) been located on levels of the facility above the flood elevations? Suggestions: since the facility may require continued use even during flood, the potential for flooding should be recognized and steps taken to minimize loss of expensive equipment and irreplaceable data.	Choose one from the following options		
		Type1, if located above flood elevation (critical contents -files, computers, servers, equipment, research, and data)		
		Type0, if not located above flood elevation (critical contents -files, computers, servers, equipment, research, and data)		
	STRUCTURAL ISSUES			

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FLOOD-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>S1</p> <p>If siting in a floodplain is unavoidable, new facilities are to be designed to account for all loads and load combinations, including flood loads</p>	<p>Do the construction type and the foundation type have the required load bearing capacity against flood water?</p>	<p>If applicable, then carryout a visual inspection. If you think that a specialist's intervention is needed for assessment then mention it in the column "REFERENCES/REMARKS"</p>		
		<p>If not applicable--> NA</p>		
		<p>Type 1, if the facilities have the required load bearing capacity against flood water?</p>		
		<p>Type 0, if the facilities do not have the required load bearing capacity against flood water?</p>		
<p>S2</p> <p>Waves can exert considerable dynamic forces on buildings and contribute to erosion and scour.</p>	<p>Is the site prone to wind driven waves, which can take place in the coastal areas, riverine areas and site next to lakes? Waves can exert considerable dynamic forces on buildings and contribute to erosion and scour.</p>	<p>If applicable, then carryout an inspection & consult historical data. If you think that a specialist's intervention is needed for assessment then mention it in the column "REFERENCES/REMARKS"</p>		
		<p>If not wave prone--> NA</p>		
		<p>Type 1, If in wave prone areas, and the issue is adressed</p>		
		<p>Type 0, If in wave prone areas, and the issue not adressed</p>		
<p>S3</p> <p>If applicable, one can provide flood openings to automatically allow for inflow and outflow of floodwaters to minimize differential hydrostatic pressure</p>	<p>Does the hospital have enclosures below the flood elevation, meant for limited use (parking, building access, and limited storage).</p>	<p>Choose one from the following options</p>		
		<p>If not applicable --> "NA"</p>		
		<p>Type 1, if hospital has enclosures below the flood elevation and is provided with flood openings to automatically allow for inflow and outflow of floodwaters to minimize differential hydrostatic pressure</p>		
		<p>Type 0, if hospital has enclosures below the flood elevation and is without flood openings to minimize differential hydrostatic pressure</p>		
<p>S4</p> <p>Refer to historical data on flooding to ascertain whether the expected water level is considerably higher than the bottom of the basement</p>	<p>If the ground water table is high and there is a basement, is it safe for water load on retaining wall?</p>	<p>If applicable, then carryout an inspection. If you think that a specialist's intervention is needed for assessment then mention in column "REFERENCES/REMARKS"</p>		
		<p>Type "NA", if not applicable</p>		
		<p>Type 1, If water table is high & retaining wall is safe for water load</p>		
		<p>Type 0, If water table is high & retaining wall is not safe for water load</p>		



EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FLOOD-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
S5 In case of significant buoyancy effect, plumbing and other service lines may break	If the ground water table is high and there is a basement, is it safe for buoyancy effect?	If applicable, then carryout an inspection. If you think that a specialist's intervention is needed for assessment then mention in column "REFERENCES/REMARKS"		
		Type "NA", if not applicable		
		Type 1, If this is applicable & safe against bouyancy effect		
		Type 0, If this is applicable & not safe against bouyancy effect		
S6 Provide adeqaute depth of foundation and other local specific measures to protect the plinth and the foundation	If the building is in a place where flood water returns with speed to the nearby canal/river or sea causing scouring	Is the plinth adequately protected and the foundation has adequate depth?		
		If not applicable --> "NA"		
		Type 1, if the issue of scouring effect has been addressed adequately		
		Type 0, if the issue of scouring has not been addressed		
NON STRUCTURAL ISSUES				
NS1 Critical facilities in hospitals that depend on fresh water should be aware of the level of vulnerability of the local water supply system, and the system's plans for recovery of service in the event of a flood.	Is the potable water supply for the facility protected from flooding? If served by a well, is the wellhead protected? Can it be accessed during flood?	Choose one of the following options		
		If not applicable --> "NA"		
		Type 1, If applicable, & the potable water source is protected during flooding		
		Type 0, If applicable, & the potable water source is not protected during flooding		
NS2 Unprotected waste water service could casue a major disaster during and after flood with a long lasting detrimental effect on public life	Is the wastewater service for the building protected from flooding? Are any manholes below the Design Flood Elevation?	Is infiltration of floodwaters into sewer lines a problem? If the site is served by an onsite system that is located in a flood-prone area, have backflow valves been installed?		
		Type NA, If not applicable		
		Type 1, if the wastewater service is protected from flooding		
		Type 0, if the wastewater service is not protected from flooding		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FLOOD-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS3</p> <p>Make sure that the tank openings and vents are elevated above the recorded elevation or the Design Flood Elevation</p>	Are there any above ground or underground tanks on the site in flood hazard areas?	Choose one from the following options		
	Are they installed and anchored to resist flotation during the design flood? is the tank openings and vents are elevated above the recorded elevation or the Design Flood Elevation?	Type NA, If not applicable		
		Type 1, if it is safe against flotation and vents elevated above recorded (historical) flood elevation		
<p>NS4</p> <p>Make sure that the vents and inlets are elevated above the recorded elevation or the Design Flood Elevation or they are sealed adequately to prevent entry of flood water</p>	Are air handling unit, HVAC systems, ductwork, and other mechanical equipment and systems located above the recorded flood elevation?	Are the vents and inlets located above flood level, or sealed to prevent entry of floodwater?		
		If not applicable--> "NA"		
		Type 1, if air handling unit, HVAC systems, ductwork, etc are located above the recorded flood elevation or sealed to prevent entry of floodwater		
<p>NS5</p> <p>If not possible, locate them to higher floors or into elevated additions</p>	Are plumbing fixtures and water meters, etc.) located above the recorded flood elevation?	Choose one of the following options		
		Type NA, If not applicable		
		Type 1, if the plumbing fixtures and water meters, etc. are above recorded (historical) flood elevation		
<p>NS6</p> <p>Apart from the fact that electrical systems are indispensable, if flooded it can lead to a major life threat</p>	Are electrical systems, including backup power generators, panels, and primary service equipment, located above the recorded flood elevation?	Choose one of the following options		
		Type 1, if the electrical systems, panels, and primary service equipment are located above the recorded (historical) flood elevation		
		Type 0, if the electrical systems, panels, and primary service equipment are not located above the recorded (historical) flood elevation		
<p>NS7</p> <p>Utility equipment that is critical for functionality should be relocated to higher floors or into elevated additions.</p>	Is the early warning system located above the recorded (historical) flood elevation	Choose one of the following options (if this facility does not exist, mention this in column "REFERENCES/REMARKS"		
		Type NA, if this facility does not exist		
		Type 1, if early warning systems are safely located		
		Type 0, if early warning systems are not safely located		

ANNEXURE IV: FIRE SAFETY EVALUATION: FOR EASE OF FILLING ANSWERS TO KEY QUESTIONS, ONLY THE COLUMN A,B,C,D & J HAVE BEEN SHOWN HERE

READ THIS BEFORE ANSWERING THE KEY QUESTIONS				
	User will read the following key questions in this column	Against each Key Question, the User will choose the appropriate answer from the given options shown in this column	User's Input 1	User's input 2: Follow the instructions in column C and type in the necessary information in this column
A	B	C	D	J

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FIRE-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
	PLANNING			
<p style="text-align: center;">P1</p>  <p style="text-align: center;">Site plan showing access roads</p>	<p>An important aspect of safety of a building is the type of access road from the main road to the site of the new hospital</p>	<p>Depending upon the type of access road to your site choose one from the following options;</p> <p>Type 1, if two or more roads from mainstreet to building wide enough to allow one fire engine to reach, reverse and return to the mainroad</p> <p>Type 2, if there is one access road of the above type</p> <p>Type 3, if access road is for cars and not fire engine</p> <p>Type 4, If the access road is suitable for motorbike only and not for cars</p> <p>Type 5, if it is for pedestrian access only</p>		
<p style="text-align: center;">P2</p> <p>Apart from site visit, the consultant should enquire about external fire hazards from local people and fire department's local office</p>	<p>With reference to the exterior of the hospital building, rate the building's exposure to external fires.</p>	<p>There could be various sources such as electrical substation, combustible materials store, etc. The consultant should visit the site to assess such potential fire hazards</p> <p>Type 1, if very high (Hospital's exposure to external fire)</p> <p>Type 2, if medium (Hospital's exposure to external fire)</p> <p>Type 3, if low (Hospital's exposure to external fire)</p> <p>Type 4, no exposure at all (Hospital's exposure to external fire)</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FIRE-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>P3</p>  <p>Site plan showing open space</p>	<p>Whether open space is available adjacent to the buildings for people to get assembled during fire?</p>	<p>In the column "REFERENCES/REMARKS, write the approximate length and width of such open space and the number of people who will need it Choose one from the following options</p> <p>Type 1, if there is adequate open space for gathering</p> <p>Type 2, if there is open space, but not adequate for gathering</p> <p>Type 3, if there is no open space for available for gathering</p>		
ARCHITECTURAL ISSUES				
<p>A1</p> <p>Careful consideration at schematic design level may eliminate most of the fire vulnerabilities in a cost effective manner</p>	<p>Is the architectural design in conformity with the latest codes of fire safety?</p>	<p>If referred to, mention the code name or similar source in Column "REFERENCES/ REMARKS" - Choose one from the following options</p> <p>Type 1, if safe against latest codes of fire safety</p> <p>Type 0, if not safe against latest codes of fire safety</p>		
<p>A2</p> <p>If yes, then relocate it</p>	<p>Is the main meter box located in the staircase block?</p>	<p>Choose one from the following options</p> <p>Type NA if not applicable</p> <p>Type 1, if the main meter box located in the staircase block</p> <p>Type 0, if the main meter box located in safe place</p>		
<p>A3</p>  <p>If yes, then consider relocating it</p>	<p>Is the main switch located in the main entrance lobby/ passage/ corridor?</p>	<p>Choose one from the following options</p> <p>Type NA if not applicable</p> <p>Type 1, if main switch is in the entrance lobby</p> <p>Type 0, if main switch is located in safe location</p>		
<p>A4</p> <p>Try to relocate possible sources of fire, e.g., kitchen, meter box, main switch, etc. from the staircase</p>	<p>Is the the existing staircase adequately protected for safe evacuation during fire?</p>	<p>Choose one from the following options</p> <p>Type "NA", if there is no staircase</p> <p>Type 1, if the existing staircase is adequately protected for safe evacuation during fire</p> <p>Type 0, if the existing staircase is not protected for safe evacuation during fire</p>		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FIRE-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>A5</p> <p>If it does not exist, build an external staircase, if possible. It should be at maximum distance from the main staircase</p>	In case of a multistorey, is there a fire escape staircase?	Suggestion: keep the fire escape stairs at maximum distance from each other		
	Use signnages	Type NA, if not applicable		
		Type 1, if there is a fire escape staircase at maximum distance from main stair		
		Type 0, if there is no fire escape stair		
<p>A6</p> <p>In case it is not possible to provide a fire fighting water tank and there is no fire hydrant nearby, look for alternative sources such as a local perennial pond</p>	Is there a fire fighting water tank of adequate size or if there is a local source for fire fighting	Choose one from the following options		
	Use signnages	Type 1, if there is a fire fighting water tank of adequate size or if there is a local source		
<p>A7</p> <p>Design a sprinkler system for the existing building. without dmaging the existing structural members</p>	In case of a large hospital, do sprinklers exist in the building?	Choose one from the following options		
		Type NA if not applicable		
		Type 1, if sprinklers have been planned for		
		Type 0, if sprinklers have not been planned for		
<p>A8</p> <p>The architect should choose appropriate materials and detailing of the false ceiling. The supporting metal structure to be provided with fire retarding coat</p>	Is the ceiling material safe from fire?	Choose one from the following options		
		Type "NA" if not applicable		
		Type 1, if ceiling materials used is not fire prone		
		Type 0, if ceiling materials used is fire prone		
STRUCTURAL ISSUES				
<p>S1</p> <p>Take special care for steel and timber members</p>	Did the designer use less fire prone materials? Or else has the structural members been insulated to protect it in the event of fire?	Did the designser provide insulation as per code for RCC, steel, timber, stone structure- mention the code name/source in column "REFERENCES/ REMARKS"		
		Type 1, if structural members insulated adequately or less fire prone building materials are used		
		Type 0, if structural members not insulated and/or fire prone building materials are used		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FIRE-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
	NON STRUCTURAL			
<p>NS1</p> <p>Use only national standard's approved products and also based on past experience</p>	<p>Is the quality of wiring used of adequate quality</p>	<p>Choose one from the following options, mention in column "REFERENCES/REMARKS", if there is no electricity</p>		
		Type NA if there is electricity		
		Type 1, if used wires are of national standards' approved quality		
		Type 0, if used wires are not of national standards' approved quality		
<p>NS2</p> <p>Use earthing pit of 1mX1mX2.5m deep installed with Galvanized cast Iron Plate. Alternatively, one may use specifications as per the local practice</p>	<p>Has earthing been done in the wiring system?</p>	<p>Choose one from the following options, mention in column "REFERENCES/REMARKS", if there is no electricity</p>		
		Type NA if there is electricity		
		Type 1, if earthing has been done		
		Type 0, if earthing has not been done		
<p>NS3</p> <p>Your building may not need it, if there are adjacent buildings provided with lightning bars</p>	<p>Has Lightning bar been fixed in the building</p>	<p>Choose one from the following options, mention in column "REFERENCES/REMARKS", if there is no electricity</p>		
		Type NA if there is electricity		
		Type 1, if Lightning bar been fixed or there is a nearby tall building with lightning bar or a tower		
		Type 0, if Lightning bar not been fixed		
<p>NS4</p> <p>If yes, then try relocating it</p>	<p>Is the emergency batteries such as Inverter located near the entrance to the building?</p>	<p>Mention in column "REFERENCES/REMARKS" if there is no batteries</p> <p>-Choose one from the following options</p>		
		Type "NA", if there is no emergency battery		
		Type 1, if emergency batteries such as Inverter located safely in the building		
		Type 0, if emergency batteries such as Inverter located in the entrance lobby of the building		

EXPLANATIONS/ SKETCHES	KEY QUESTIONS ON FIRE-SAFETY OF EXISTING HOSPITAL	GUIDANCE NOTES + POSSIBLE ANSWERS TO KEY QUESTIONS	Answer As per Guidance	REFERENCES/REMARKS
<p>NS5</p>  <p>Strap them adequately with the walls</p>	<p>Is there a fire extinguisher kept at convenient place for fire fighting</p>	<p>Choose one from the following options</p> <p>Type 1, if a fire extinguisher kept at convenient place for fire fighting</p> <p>Type 0, if there is not fire extinguisher in the building</p>		
<p>NS6</p> 	<p>Is there a provision for fire alarm?</p>	<p>Choose one from the following options</p> <p>Type 1, if there is provision for fire alarm</p> <p>Type 0, if there is no provision for fire alarm</p>		

ANNEXURE V: SUPPLEMENT TO TOOLKIT II: HOSPITAL CONDITION ASSESSMENT: SUPPORT TO HIIS²

Health database is updated periodically by the Health department. At present it is maintenance centred. This Supplement to the Toolkit Part II intends to act an aid to the existing Health Infrastructure Information System (HIIS) forms. At present HIIS is maintenance centred. This Supplement intends to act as an aid to the existing HIIS forms. It is envisaged that this supplement will enhance the ability of the medical staff to fill in the forms more accurately than at present. This supplement also aims to acquire some amount of retrofitting related data on non-structural risk. While the Toolkit II will provide a comprehensive picture on retrofitting needs, this supplement will provide data on the actual physical condition of the building and facilities. These two combined will enable the top level management to assess the retrofitting cum maintenance needs, prioritize and decide whether detailed investigation is required for a particular building. The following is a suggested addition to the existing HIIS data collection form.

Special Note: The Infrastructure department of health to treat the tables in this section as additions to the existing database

PREPARE A SITE PLAN: PROPORTIONATE SKETCH

The survey should be done by health staff, local mason and, if possible, a JE. The first job of the team will be to carry out the following.

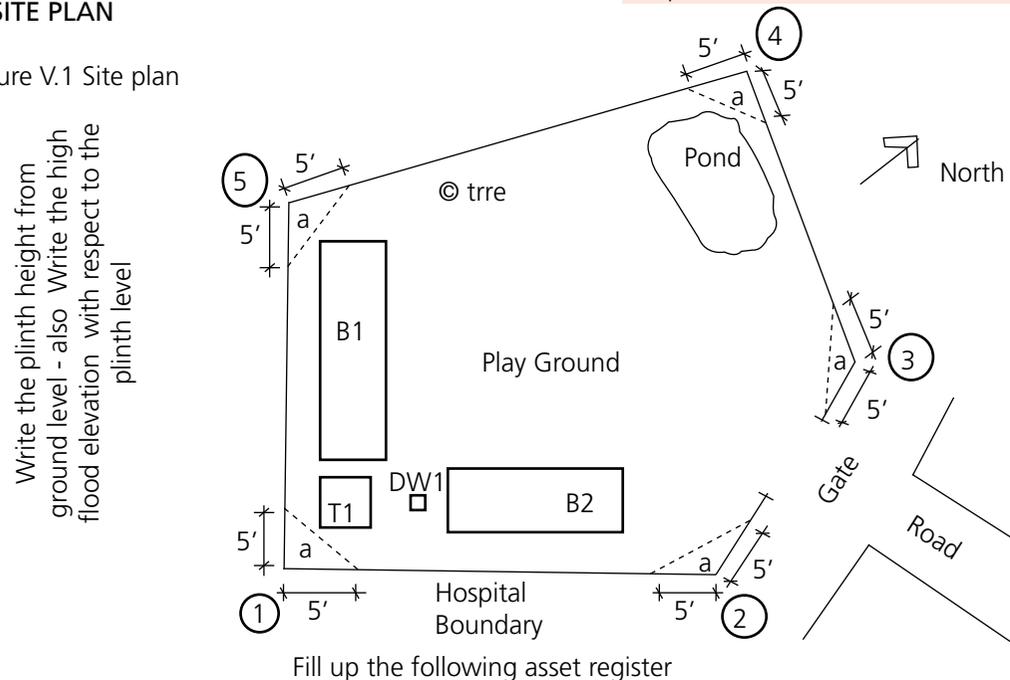
- Draw the campus boundary first
- Draw the open spaces and write on the paper such as play field, water body etc.

- Draw the buildings and mark them as B1, B2 etc.
- Mark the rooms of each building as B1/R1,R2,...., B2/R1.R2,.... etc.
- Draw the toilets T1, T2 , DW facilities DW1, DW2 and the disposal system ,
- Write the evacuation road width
- Draw the big trees inside and near the compound
- For each building use the format in the following pages and carryout the defect identification and recording.
- Mark the highest observed flood water level on the wall of one of the existing buildings, if applicable

- At corner 1, 2, 3, 4 and 5 mark at 5' as shown in the above figure and the measure the distance "a1, a2, a3, a4" at all five corners.
- Measure 1-2, 2-3, 3-4, 4-5 and 5-1 and write on the above drawing
- First measure the plinth height of B1 or B2 and mark on the drawing as shown. Take a level pipe and mark the high flood level of the plinth level. For example, if the high flood level is 2' below the plinth, then write HFL (-2'). In case the high flood level is 3' above the plinth level then write HFL (+3')
- Write about existing use pattern of the adjacent plots

AN ILLUSTRATED EXAMPLE OF HOW TO PREPARE A SITE PLAN

Figure V.1 Site plan



² Health Infrastructure Information System: Health infrastructure data collection system: Nepal

Table V.1: Asset Register: Record of the hospital buildings and their physical conditions: Use separate pages if necessary

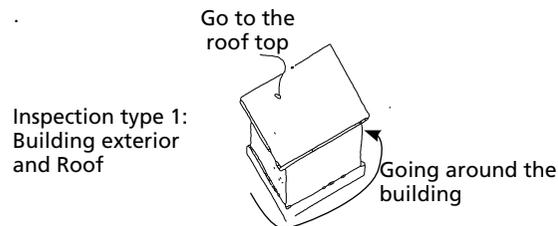
Facilities mark as/ site plan	No of storey	Function and no of rooms	Who constructed	Age in years	Construction Cost	maintenance history	Type of construction methods adopted in the building				Impression on maint. need **
							Foundation	Wall	Roof	Floor finish	
e.g, B1		e.g. class/8 rooms					e.g. wall footing in brick + cement mortar	e.g., brick wall in cement mortar	RCC	Cement floor	
e.g. B2		e.g. office/2 rooms									

** Type 1 if building/ facility is in good condition - no need for maintenance, Type 2 if building/ facility is in OK condition, need for routine maintenance, Type 3 if building/ facility needs minor repair, Type 4 if building/ facility needs major repairs, Type 5 if building/ facility is unsafe – to be replaced

THE INSPECTION PROCESS


Tools Required For Inspection: Carry a small hammer, 20 ft long level pipe, a plumb, a 30 m tape, papers, one graph paper A3 size, one ladder, 1mm, 2mm, 3mm, 4mm wires, coloured chalks.

Inspection: Use the following checklists to determine which items require attention and then determine what action should be taken. The areas of the hospital buildings to be inspected are the following:



Inspection type 1: Building exterior and Roof

- Inspection type 2: Building interior
- Plumbing
 - Electrical
 - Furniture and equipment



HOW TO CARRY OUT THE INSPECTION

The inspection will start with primarily visual observations of the inside and outside of the hospital, simply by walking around the interior and the exterior. Use the hammer and level pipe wherever asked for in the following format.

GENERAL NOTES FOR INSPECTION TEAM MEMBERS


Hairline cracks in concrete columns, beams, structural walls, and floors are usually of less concern – these may be deferred. However, if the cracks are of

following types, survey team should consult an engineer.

- if the cracks are more than 4mm wide;
- if they appear to be getting larger,
- if water is seeping through the cracks.

INSPECTION TYPE 1: THE BUILDING EXTERIOR

A visual inspection of the exterior of the hospital building should be done by looking for the following in Table V.2- presence of these indicate that maintenance action is needed.

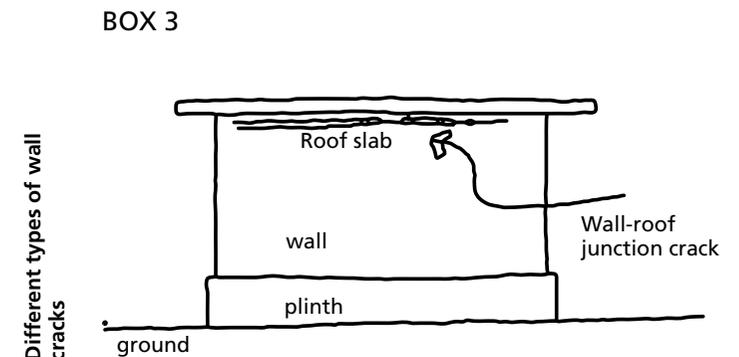
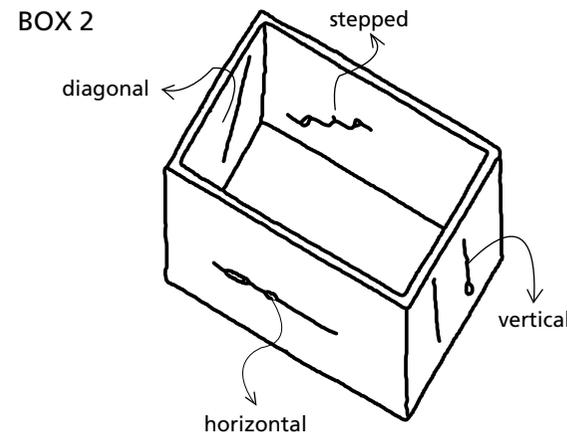
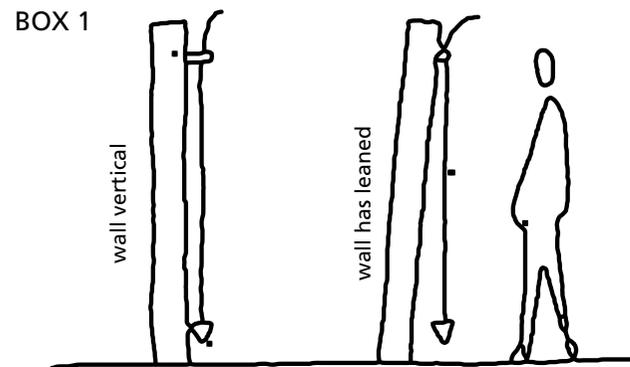


In exterior brick, concrete block, or any masonry walls, the basic concerns are cracking and water intrusion.

Water can affect masonry in different ways. Over a period of time, water can erode the mortar, causing the original mortar mix to disintegrate. If there are cracks, there are more openings for water to enter. Cracks must be filled to avoid water getting inside and causing further deterioration of the surface.

Table V.2: Do not fill up if the defect does not exist. Make a special mention of those cracks that have appeared since the last observation

Building component	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Priority of importance– Urgent/ Important/ Medium/ low
Walls			
Box 2	Is there a vertical crack on the wall- wider than 1mm? if yes measure the width & length- does water seep through?		
Box 2	Is there a horizontal crack in the wall – wider than 1 mm? is it stair stepped? - does water seep through? measure length		
Box 2	Is there a diagonal crack in the wall – wider than 1 mm? - does water seep through? measure length		
Box 1	Is any wall out of plumb? Bend/twist/ deformed		
	Is there a crack where two walls meet? measure length		
	Is there damp patch on wall? measure length		
	Is there presence of any damaged plaster? Tap the wall plaster with a small hammer- if dull sound is emitted mark the damaged portion and measure the area		
Box 3	Is there a crack at wall-roof junction? measure length		
	Is there a whitish film deposited on the wall, this is called efflorescence and is the result of dried mineral salts. Measure area		



Different components of the building	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Priority of importance– Urgent/ Important/ Medium/ low
Corridor railings and posts			
Paints	Peeling of paint? Is there stain on wall? Room looking shabby? Measure area		
	Check the same as above for door, window and grills, Measure area		
Others	algae or mold that is now growing on walls, bushes and shrubs that now touch the hospital building's exterior. Trees growing from, wall, roof, etc.		
	Is there a plinth protection? is the existing plinth protection damaged? Measure area		
Differential settlements Box 5	Carryout the investigation as in the footnote**. If differential settlement > 2", mark the location in plan. measure length		

** Select any one corner of the room and mark with a pencil at a height of 3 feet from the floor level. With water level pipe mark at all four corners of the building matching with the first mark. Measure the heights of these marks from the ground. Check whether there is a difference of greater than 2" at any one corner.

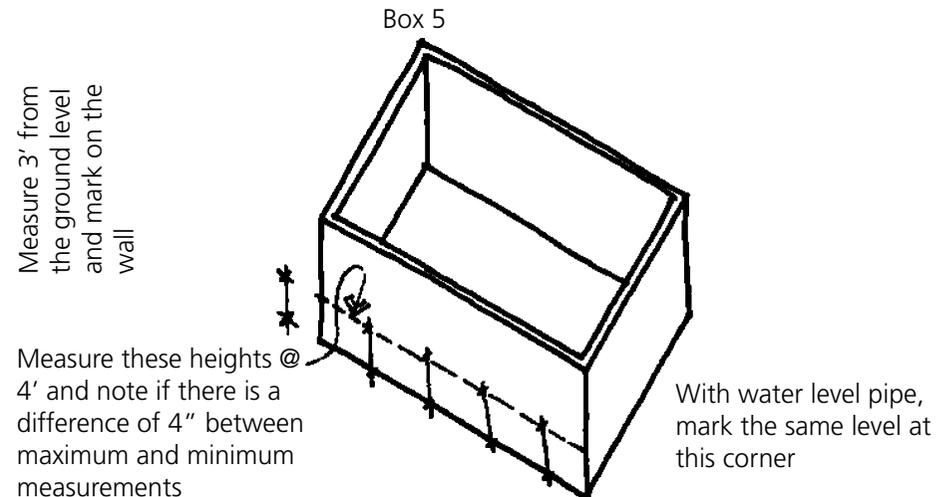
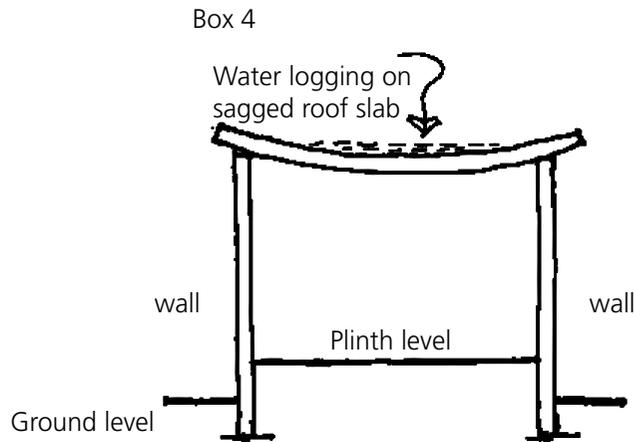


Table V.3 ROOF STRUCTURE : Go to the roof top for inspection

	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Actions/ priority
Roof	Does the roof top appear undulating? Deflected?		
Box 4	Is there water logging on the roof? Is it at places – mark with a chalk and measure the area		
	Is the rainwater down pipe chocked? Horizontal spouts blocked?		
	Can you see damaged waterproofing on the roof top? If you cannot see that then tap the roof surface with a hammer – if dull sound is emitted then mark the places where it exists and measure the area		

INSPECTION TYPE 2: BUILDING INTERIOR INCLUDING CORRIDORS

Look for cracks that are visible either on one side or both. Pay special attention to them. The horizontal cracks need special attention. A vertical crack, or one that is stair shaped (see box 2), could be due to differential settlement. If there is crack where the walls join other elements such as roof slab to wall, wall-beam- wall-column, create a groove in the plaster to hide the crack.

- Inspection type 2:
Building interior
- Plumbing
 - Electrical
 - Furniture and equipment

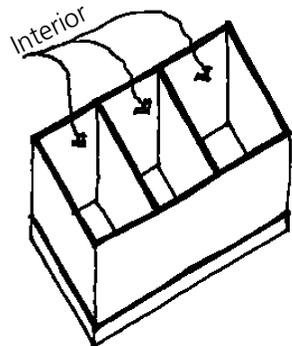



Table V.4 Do this inspection Room by room of each building, e.g., B1, B2,


	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Priority of importance– Urgent/ Important/ Medium/ low
COLUMNS	If emits dull sound when struck lightly on surface with a hammer. Measure length		
Timber, steel, RCC	Vertical cracks width more than 1 mm- measure the length and width of crack. if water seeps through such cracks, measure length		
	If damaged corners exist, measure length		
Box 7	If out of plumb by >2", treat it as urgent		
Box 6	are there visible reinforcing rods? Has the rods bulged? measure length		
	If there is exposed rods but the column is not out of plumb or the rods are not bulged		
Any others			

Box 6

Reinforced cement concrete column- rods exposed and cover concrete eroded



If the rods of the column shown on the left has buckled as shown below, consult an engineer



Box 7

If the rods of the column shown on the extreme left has leaned as shown below, consult an engineer

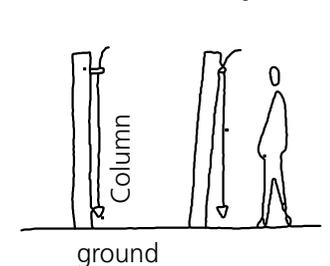
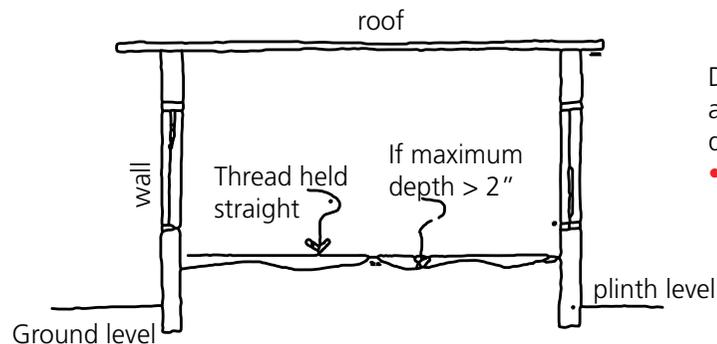


Table V.4 contd.. is Room by room

	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Priority of importance– Urgent/ Important/ Medium/ low
Masonry Walls	Is there a vertical crack on the wall- wider than 1mm? if yes measure the width & length		
	Is there a horizontal crack in the wall – wider than 1mm? is it stair shaped? Is there water seepage thro' that?		
	Is there a diagonal crack in the wall – wider than 1 mm? Is there water seepage thro' that?		
	Is any wall out of plumb? Bend/twist/ deformed		
	damp patch areas? measure		
	Is there rising dampness in the wall? if yes then measure length		
Ground Floor Box 8	Undulating floor by more than 2"? measure area		
	Are there floor cracks wider then 1mm? measure length		
Box 9	Walk along periphery of room & watch the floor and wall junction – do you see a crack? Is it continuous or discontinuous? measure length		
	Is there floor dampness? measure areas		
	Is the floor finish damaged? If you cannot see that then tap the floor surface with a hammer – if dull sound is emitted then mark the places where it exists and measure the area		

Important note: for wall defects refer to the section on exterior wall

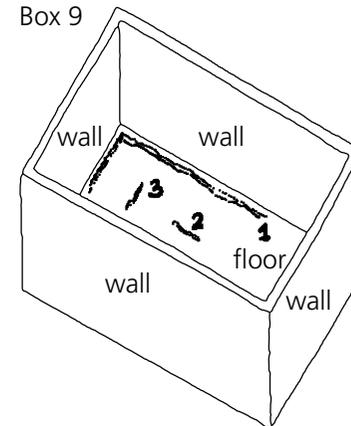
Box 8



Drawing shows the floor of a room- note if you find this defect

- hold a thread as shown by touching the highest point of the floor and check if the maximum depth of any other portion of the floor is > 2"

Box 9

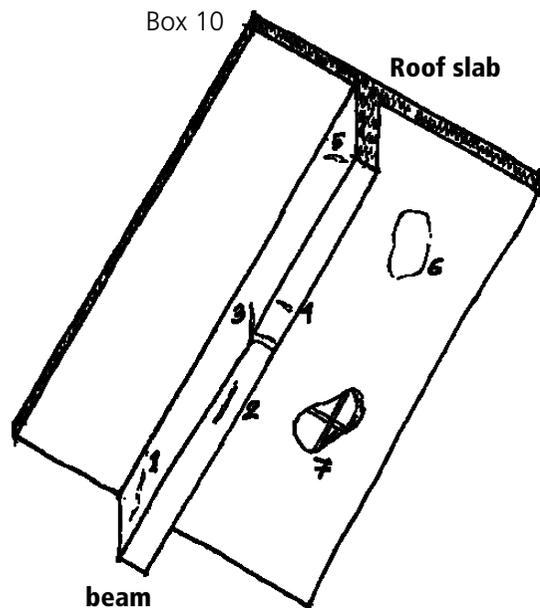


Drawing shows the floor of a room- note if you find this defect

- Crack type 1 at wall-floor junction
- Crack type 2 and/or 3 on floor

Table V.4 contd.. is Room by room

	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Priority of importance– Urgent/ Important/ Medium/ low
BEAMS	Emits dull sound when struck lightly on surface with a hammer		
RCC, timber, steel	Cracks- across at mid span or diagonal cracks at ends		
	Damaged corner		
	Has the beam Deflected ?		
	Cover concrete crack of fallen off		
Ceiling	Can you see that the roof has sagged?		
	Is there a prominent damp patch in the ceiling – is water seeping through crack- measure area		
Box 10	Is there a visible crack in the ceiling at mid span and near supports		
	Is concrete falling off in patches? Can you see the rods- measure area		



Drawing shows the ceiling and beam- note if you find

- Crack type 1 at beam ends
- Crack type 2 and/or 4 on beam bottom
- Crack type 3 at mid span
- Exposed rods as in 7
- Cover concrete fallen off

Table V.4 contd.. is Room by room

	Do the following defects exist? Record if other types, not mentioned here, exist on the exterior.	Where are the unsatisfactory components located as/ Table V.1? write the quantities for each defect	Priority of importance– Urgent/ Important/ Medium/ low
Lintel over window & door opening	has the lintel deflected? Do you see the rods?		
	Look at the bottom of the lintel - is there a crack across the width and at centre?		
	Is there a crack at wall support?		
Interior windows	Do windows should open and close easily? if defect exists mention number of such cases		
Window shutter	Are there damaged Window shutters? if yes measure area		
Plastering	With a small hammer, tap the wall, ceiling, beam, column etc. that has plaster - if dull sound is emitted mark the area- re-plastering is necessary		
Paints	Peeling of paint? Is there stain on wall? Room looking shabby? measure area		
	Check the same as above for door, window and grills		
Other			
Remarks			

How do you check deflection? With water level pipe mark two ends of the lintel and hold a thread tightly along the marks. Deflection will be visible.

FURNITURE, WATER, SANITATION, ELECTRICAL

Table V.5: Condition assessment of furniture/equipment

Furniture/ Equipment	Age of facility in years	Total Nos	Repair needs (nos)	Replacement needs (nos)	Supply of new (nos)	Priority- urgent, important, less important
Furniture/ fixture						
Central Air-Con Unit						
X-ray Equipment						
CT Scan Machine						
MRI Machine						
Electric Generator						
Boiler						
Hydrotherapy						
Pool						
Respirator						
Suction machines						
Anesthesia machine						

Substations						
Refrigerator /freezer						
Television Sets						
Racks						
Book shelves						
Water Supply + Sanitation						
Water tanks						
Sinks						
Faucets						
Tanks						
Septic Tank						
Electrical						
Control panel box						
Switches and sockets						
Internal lighting (lamps and bulbs)						
Exterior lighting						
Fans						
AC unit						

Table V.6: Retrofitting Needs of Furniture And Equipment

Furniture/ Equipment	Age (years)	If anchored, how many years back	Location--> GF(1) /FF(2) /SF(3) /TF(4) />TF(5)	Anchorage → Type 1, If yes, 0, if no			Material of anchorage, type 1, where applicable			Present condition of the anchor Good as new (1), OK(2), min. maint. (3), medium maint (4), major maint (4),replacement (5)	Mention the level of equipment/furniture Type 1, If PL > 300mm from HFE, Type 2, if lower than HFE, Type 3, of < 300mm below HFE	Type 1 if protected from high wind, type 0 for no
				At base	On top	at sides	Metal	wood	other			
Central AC Unit												
X-ray Equipment												
CT Scan Machine												
MRI Machine												
Electric Generator												
Boiler												
Hydrotherapy												
Pool												

Respirator												
Suction machines												
Anesthesia machine												
Substations												
Refrigerator /freezer												
Television Sets												
Racks												
Book shelves												
All non structural elements (eg: file racks, Books shelves etc)												

** this should be supplemented with photos

SUMMARY OF DEFECTS:

Hospital administration should gather the statements below in order to come up with a consolidated list of defects and prepare a maintenance plan and budget. In case maintenance process is simple and within the capabilities of the hospital staff, a time frame and cost can be estimated. If the maintenance needs a lot of money (decide the ceiling) and/or the repair items are beyond their capabilities, the departmental engineers will inspect the hospital site and accordingly prepare a budget. The acquired data should be tabulated by the hospital staff and checked by the local level engineer. The checked data will be sent to the district for logging it into the computer against the HHS number of the hospital, which will be sent to the Department of Health

Table V.7: Summary of defects

HOSPITAL BUILDING MAINTENANCE PROGRAMME								Date of inspection	
Name of person who filled out the form:									
List of problems according to priority									
Sl no	Defect type	Defect description	Age of the facility	Location of the defect	Quantity-volume/ Area/ length	Unit cost	Estimated cost	Time frame	priority
1									
2									
3									
4									
5									
6									
7									
8									
9									
10									

ANNEXURE VI FIELD TEST: MULTI-HAZARD RETRO-MAINTENANCE NEED ASSESSMENT HOSPITAL AT BHAKTAPUR, NEPAL

Figure VI.1: Field test: Hospital at Bhaktapur, Nepal

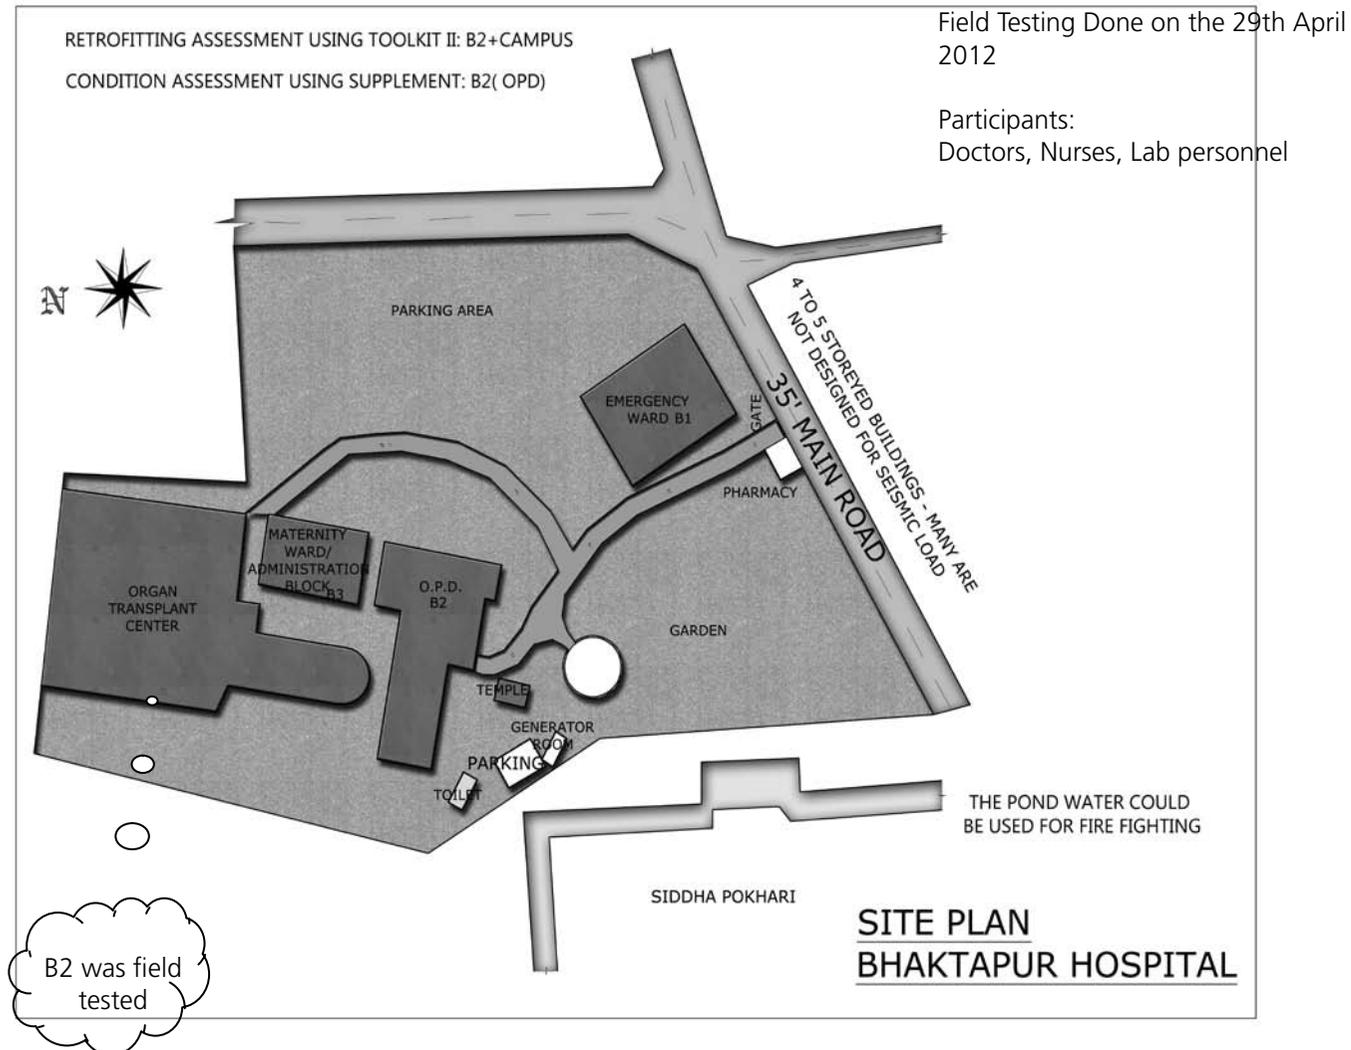


Figure VI.2: Condition Assessment of Building B2 (Out Patients' Department)



Figure VI.3 The process of field test and some defects in Building B2 (out patients' department)



Participation: Medical Staff, Doctors, Nurses, etc. Capacity building & introducing retro-maintenance forms

Defects: A Few Examples, the medical staff took part in identifying the defects and record them as per the supplement

Table VI .1: Asset Register

Facilities mark as/ site plan	No of storey	Function and no of rooms	Who constructed	Age in years	Construction Cost	maintenance history	Type of construction methods adopted in the building				Impression on maint. need **
							Foundation	Wall	Roof	Floor finish	
B1	One	3- Emergency Ward	Not known	12	Not known	Not known	Step Foundation	Brick wall in cement mortar	CGI on steel truss	Cement Floor	2
B2	Three	75- OPD,Ward, Lab, OT	government	38	Not known	Not known	Strip footing	brick wall in cement mortar	RCC	Cement floor	3
B3	Two	36- Ward, office building	Not known	7	Not known	Not known	Shallow Foundation	Brick Wall in Cement Mortar	RCC	Cement floor	2
B4	Four	70-Organ Transplant	Not known	Under construction	Not known	NA	Shallow Foundation	Brick Wall in Cement Mortar	RCC/ Steel Truss	Cement floor	NA

** Type 1 if building/ facility is in good condition - no need for maintenance, Type 2 if building/ facility is in OK condition, need for routine maintenance, Type 3 if building/ facility needs minor repair, Type 4 if building/ facility needs major repairs, Type 5 if building/ facility is unsafe – to be replaced

Table VI .2: Condition Assessment Furniture, Water, Sanitation, Electrical

Furniture/ Equipment	Age of facility in years	Total Nos	Repair needs (nos)	Replacement needs (nos)	Supply of new (nos)	Priority- urgent, important, less important
Furniture/ fixture						
Central Air-Con Unit	NA		NA			
X-ray Equipment	16	4				
Electric Generator	15	2				
Boiler	4	4				
Suction machines	6	4	2			Urgent
Anesthesia machine	4	1				
Refrigerator /freezer	3	6				
Television Sets	5	1	1			Important

Racks	3	15	4			Important
Book shelves	11	4				
Oxygen Cylinder	NA	18				
Oxygen Concentrator	NA	2				
Water Supply + Sanitation						
Water tanks	4	6	2			Urgent
Sinks	4	6	2			Important
Tanks	4	5	1			Important
Septic Tank	16	1				
Electrical						
Control panel box	25	1				
Switches and sockets	5	2				
Internal lighting (lamps and bulbs)	4	2				
Exterior lighting	4	1				
Fans	5	3	1			Important
AC unit	3	1				

Table VI .3: Retrofitting Needs of Furniture and Equipment

Furniture/ Equipment	Age (years)	If anchored, how many years back	Location--> GF(1) /FF(2) /SF(3) /TF(4) />TF(5)	Anchorage → Type 1, If yes, 0, if no			Material of anchorage, type 1, where applicable			Present condition of the anchor Good as new (1), OK(2), min. maint. (3), medium maint (4), major maint (4),replacement (5)	Mention the level of equipment/ furniture Type 1, If PL > 300mm from HFE, Type 2, if lower than HFE, Type 3, of < 300mm below HFE	Type 1 if protected from high wind, type 0 for no
				At base	On top	at sides	Metal	wood	other			
Central AC Unit	NA										NA	
X-ray Equipment	17	17	1	1			1		3	1	NA	
Oxygen cylinder	3	NO								1	NA	
Oxygen concentrator	9	NO								1	NA	
Generator	15	15	1	1			1		2	1	NA	
Boiler	5	5	1	1			1		2	1	NA	
Anaesthesia machine	4	NO	1							1	NA	
Suction machine	6	NO	1							1	NA	
Refrigerator /freezer	3	NO	3							1	NA	
Television Sets	5	NO	2							1	NA	
Racks	3	NO	1,2,3,4							1	NA	
Book shelves	12	NO	3							1	NA	
All non structural elements (eg: file racks, Books shelves etc)		NO	1,2,3,4							1	NA	

** this should be supplemented with photos

Figure VI.4: Almost all the furniture and equipment are highly vulnerable against earthquake



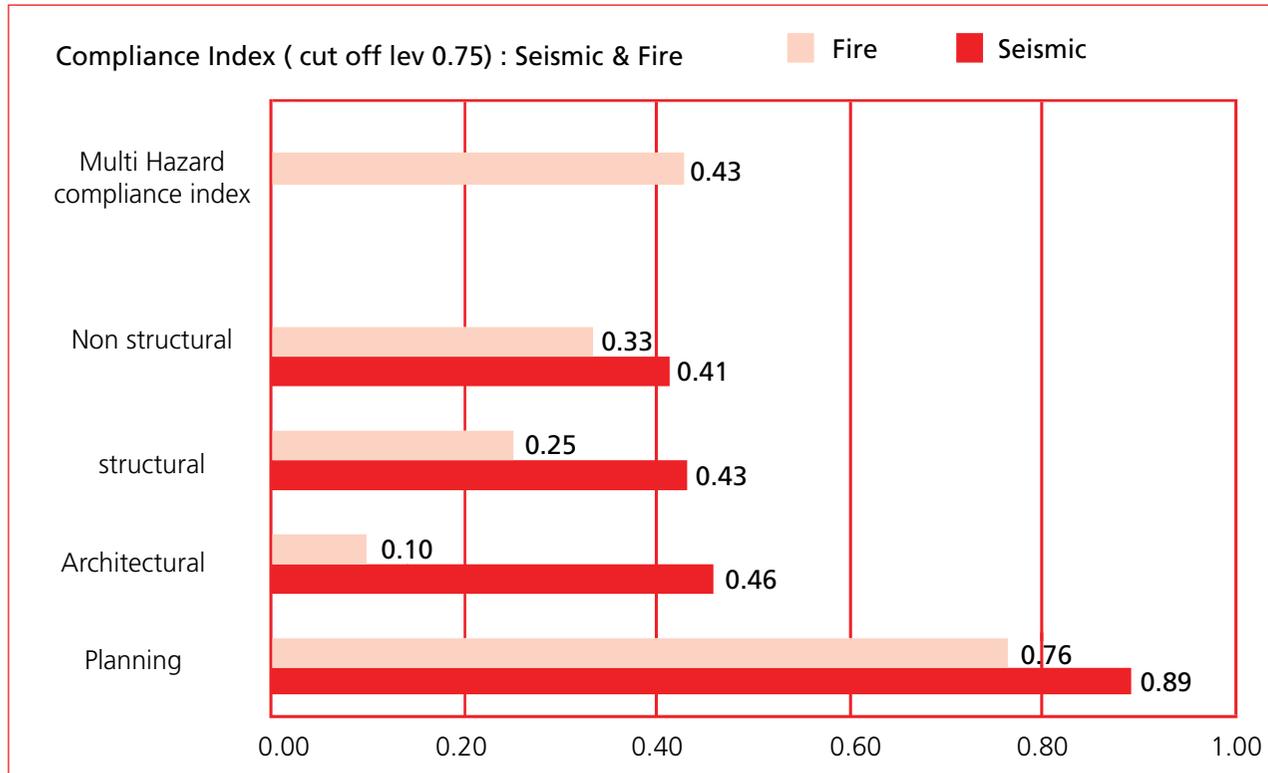
Table VI .4: Summary of defects

HOSPITAL BUILDING MAINTENANCE PROGRAMME					Date of inspection:			29th April, 2012	
Name of person who filled out the form: Ratna Suwal, Binod Shrestha									
Sl no	Defect type	Defect description	Age of facility	Location of the defect	Quantity-volume/ Area/ length	Unit cost	Estimated cost	Time frame	priority
1	Crack	Horizontal crack in the wall – wider than 1mm	38 yrs	B2/R21 in lintel	8m+3m=11m				Medium
2	Dam patch	Damp patch on wall\		B2/R20, B2/R34, B2/R33, B2/ R79; B2/R68 6, B2/R67; landing of second floor	3sqm+12 Sqm+ 12 Sqm +2 Sqm +4Sqm+ 6Sqm+ 20 Sqm =				Important
3	Damaged plaster	Dull sound when tapping the wall plaster by hammering		B2/R19, B2/R15, B2/R14, R16;, B2/R47, R55, B2/ R34, B2/R63, R74	1 sqm +5Sqm +2Sqm +4 Sqm +2 Sqm +2Sqm +1 Sqm +6 Sqm +2Sqm =25Sqm				Important
4	Damaged paint	Peeling of paint, Is there stain on wall, Room looking shabby		Toilet, B2/R4, GF corridor, B2/R47	6sqm +36 Sqm +20 Sqm + 5 Sqm = 67 Sqm				Medium
5	External wall	Growth of algae or mold on walls, bushes and shrubs touch the hospital building’s exterior. Growth of trees on wall, roof, etc.			On North Face				Urgent
6	Plinth protection	Damaged plinth protection			North East 6 m long				low
7	Floor finish	Damaged floor finish		B2/R19, B2/R55;	42 sqm + 1 Sqm= 43 Sqm				Important
8	Distressed roof	Damp patch in the ceiling , water seeping through crack, visible crack in the ceiling at mid span and near supports, concrete falling off in patches		B2/R14, B2/R21, R67 , B2/R33, B2/R63, B2/ R18	6 Sqm +6 Sqm +10 Sqm= 22 Sqm 5m 2qm+2qm = 4qm				Urgent
9	Window shutter	There damaged Window shutters			5x(1.5mx1m)= 7.5 Sqm, on external walls				Medium
10	Front columns out of plumb, unreinforced	In strong seismic force, these might collapse							Urgent

RETROFITTING NEED ASSESSMENT (USING TOOLKIT II)

Compliance index 0 → No safety as per norm , 1 → 100% Safety as per norms

Figure VI.5: Showing Scores: Seismic, Fire and Multi-Hazard Safety



The weights shown on the right were put forward by the Expert Group Meeting Held at Kathmandu (25th -26th March 2012). However, in any other context, the country level experts may change these to suit the local conditions.

The following two Tables show the retrofitting needs of building B2

Figure VI.6: Weights considered

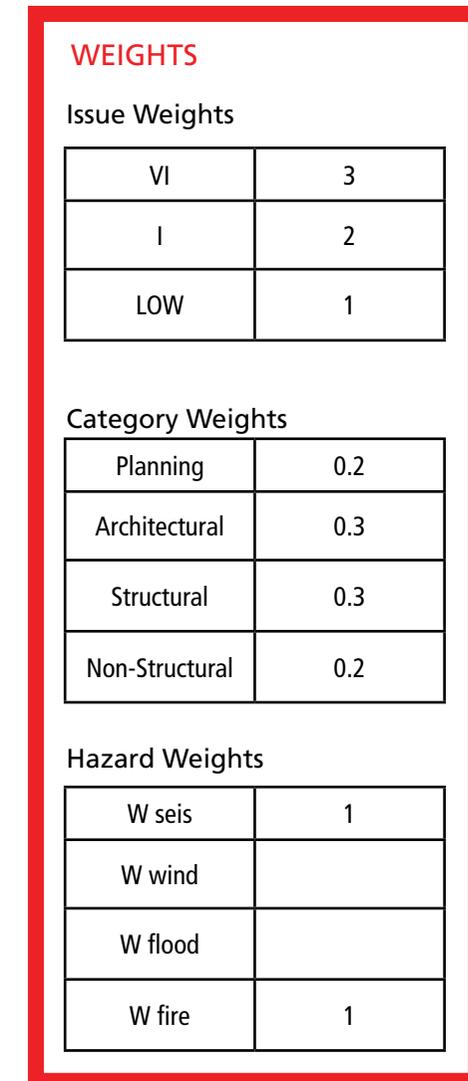


Table VI .5: Retrofitting actions to be taken to enhance SEISMIC SAFETY of hospital at Bhaktapur

ISSUE NO	ISSUES	SEISMIC SAFETY COMPLIANCE INDEX	REFERENCES/ REMARKS
PLANNING ISSUES			
P4	Type 3, If in-house backup sources of only b)power or c)gas have been provided in the hospital for 24-48 hrs	0.5	
ARCHITECTURAL ISSUES			
A1	Type 3, if Shapes are irregular and structure is not uniform	0.05	This is rather difficult to rectify
A3	Type 3, if the design is poor for evacuation of physically challenged people	0.1	
A4	Type 4, there is no emergency exist in design	0.05	This could be done without much of financial requirements
A7	Type 3, if parapets are not restrained at all	0.05	
A8	Type 3, if Medium level of variation of length/ breadth/ height ratio from safe limit	0.50	
STRUCTURAL ISSUES			
S2	Type 4, If the building is not based on structural system according to soil condition	0.25	
S3	Type 2, if liquefaction is applicable and it was not considered in design	0.05	
S5	Type 4, If no horizontal band and vertical reinforcements provided		
S6	Type 2, if ductile detailing is partially done	0.5	
S9	Type 0, If load of mechanical equipment, batteries have not been considered in design	0.25	Minimum investment is needed to comply with safety norms
NON STRUCTURAL ISSUES			
NS2	Type 0, if plumbing lines & rooftop/overhead water tank are not supported & secured or there is no water supply	0.25	
NS4	Type 0, if you have not provided flexible joints and the lines clamped at suitable points	0.05	This is a very important issue and must be complied with - urgent
NS5	Type 0, if suspended lighting fixtures are not securely attached and braced	0.25	
NS9	Type 0, if heavy mechanical equipment not secured	0.05	Urgent
NS16	Type 0, if base isolation has not been done for generator	0.25	

Table VI .6: Retrofitting actions to be taken to enhance FIRE SAFETY of hospital at Bhaktapur

ISSUE NO	ISSUES	FIRE SAFETY COMPLIANCE INDEX	REFERENCES/ REMARKS
	PLANNING ISSUES		
P2	Type 1, if very high (Hospital's exposure to external fire)	0.05	
	ARCHITECTURAL ISSUES		
A1	Type 0, if not safe against latest codes of fire safety	0.05	
A2	Type 1, if the main meter box located in the staircase block	0.05	Most urgent intervention
A3	Type 1, if main switch is in the entrance lobby	0.05	Most urgent intervention
A4	Type 0, if the existing staircase is not protected for safe evacuation during fire	0.25	
A6	Type 0, if there is no fire fighting water tank of adequate size nor a local source	0	This could be improved by simply making connection with the adjacent Siddha Pokhari
A8	Type 0, if ceiling materials used is fire prone	0.05	
	STRUCTURAL ISSUES		
S1	Type 0, if structural members not insulated and/or fire prone building materials are used	0.25	
	NON STRUCTURAL ISSUES		
NS1	Type 0, if used wires are not of national standards' approved quality	0.25	This is a very serious issue
NS3	Type 0, if Lightning bar not been fixed	0	Most urgent intervention
NS4	Type 0, if emergency batteries such as Inverter located in the entrance lobby of the building	0.25	
NS5	Type 0, if there is not fire extinguisher in the building	0.25	
NS6	Type 0, if there is no provision for fire alarm	0.25	

SUMMARY OF OBSERVATIONS

The approach road to the hospital had three to five storey buildings on one side. Many of them did not appear to be safe against earthquake. Apart from that, in case of fire in these buildings, the approach road could become difficult for the fire engine to access.

A few rooms in the hospital, where papers were stored, had the highest potential of fire hazard. Apart from that, electrical meter box in the stair well, poor electrical wiring, lack of fire alarm and fire extinguisher, etc. were potential threats to the hospital.

The hospital did not have water reservoir for fire righting. However, its fire safety could be enhanced by installing a pumping system connecting the adjacent Siddha Pokhari (pond). It was reported by the local people that substantial quantity of pond water is available round the year.

The condition assessment revealed that regular housekeeping and routine maintenance have been neglected for a long time. The distresses were identified and recorded by the team consisting of a trainer and the medical staff of the hospital. The participants agreed that an increased awareness and capacity building would have eliminated most of the defects. Because of long neglect on maintenance, the roof of B2 was damaged. The medical staff, directly involved in the survey, realized that it is they who can keep up the hospital by close vigilance on the building and its facilities. The detailed list of distresses is in Table VI .4.

ENDING REMARKS

This is Hospital Safety Toolkit Book 2: Retro-maintenance, Multi-Hazard Safety Compliance

It has provided the following four sets of data collection forms

1. Seismic Safety Evaluation
2. Wind Safety Evaluation
3. Flood Safety Evaluation
4. Fire Safety Evaluation
5. Condition assessment

The surveyors/users should read these forms before initiating the investigation for retrofitting. Only the relevant forms should be used for examining safety

The retrofitting assessment of building B2 revealed that the major problem was in seismic safety of the equipment. Most of them were very expensive and some were life supporting. Figure VI.5 shows that the non structural safety compliance index is below 50% both for fire and earthquake. Table VI .3, shows the detailed list of non structural risks. The assessment revealed that most of the equipment would simply topple or get deflected during earthquake. Some of the equipments were on roller base for easy movement. These would turn out to be fatal during earthquake. There is a strong need for anchoring them. Massive oxygen cylinders were kept upright without strapping them to the walls. The interventions would be in terms of strapping the equipments with the wall and using locks in the roller bases. Such works would require a small amount of money, though the safety will be enhanced significantly. As on today, if there is an earthquake, there will be major damage of the equipments and the emergency section including the operation theatre might even become non functional. Figure VI.4 shows some of the vulnerable equipment and furniture.

The doctors, nurses, laboratory people took part in the day long exercise in the field testing. It had made them adequately aware on the way one should look after a hospital to identify gaps and record data. The exercise was intended to enable the medical staff to monitor the building and facilities on a regular basis.

compliance of the existing building since all four hazards may not be applicable at every site.

The condition assessment should be carried out by using the “Supplement”. By comparing the needs of retrofitting and maintenance, the top level management can plan for retro-maintenance interventions. These two will enable the top level management to screen out those where detailed investigation will be necessary by involving the specialists.

This toolkit was not planned to be a finished product. However, it is suggested that the toolkit be used as it is for at least a few years. Only after the full cycle of data collection, analysis and decision making one may think of making modifications to fine tune the toolkit and to make it local specific.

REFERENCES

1. Ahmed Shameem, Ahmed AH Towfique, (2010), Disaster Risks and Risk Mitigation in Dhaka/Other Cities, New Delhi.
2. Arya Anand S., (2007), Seismic Safety of Non-Structural Elements and Contents in Hospital Buildings, Draft Guide Version 1.0, Disaster Risk Management Programme, Government of India, UNDP New Delhi,
3. Building Bulletin 100 (2007), Design for fire safety in schools, Department for children, schools and families (UK)
4. Dixit Amod Mani, Acharya Surya Prasad (2010), Implementing Earthquake Vulnerability Reduction Program in Schools in Nepal, Workshop Report, National Workshop on School Earthquake Safety, Ministry of Education (MOE), Nepal, Asian Development Bank
5. FEMA 348 (1999), Protecting Building Utilities From Flood Damage, Principles and Practices for the Design and Construction of Flood Resistant, Building Utility Systems, Mitigation Directorate, 500 C Street, SW Washington, DC 20472
6. FEMA P-424 (2010), Risk Management Series, Design Guide for Improving School Safety in Earthquakes, Floods, and High Winds
7. FEMA 577 (2007), Risk Management Series, Design Guide for Improving Hospital Safety in Earthquakes, Floods, and High Winds
8. GFRDD (undated), Developing a Strategy for Improving Seismic Safety of Schools in Nepal, in cooperation with the Disaster Risk Management Practice Group of the World Bank South Asia Region
9. GHI (2001), Final Report Global Earthquake Safety Initiative (GESI), Pilot Project GeoHazards International, United Nations Centre for Regional Development
10. GHI (2005), Identifying Earthquake-Unsafe Schools And Setting Priorities To Make Them Safe, A Case Study In Gujarat, India, GeoHazards International,
11. Gibbs, T, Browne, H.E. (1982), The Barbados Homebuilder's Guide to Hurricane Resistant Design, National Council of Science and Technology, Bridgetown, Barbados
12. Government of Delhi, (2007), Non-Structural Risk Reduction Handbook for Schools, Steps Towards School Safety, Delhi Earthquake Safety Initiatives, Delhi Disaster Management Authority, GeoHazards International, SEEDS India, USAID
13. Guragain Ramesh, Pandey Bishnu Hari (2003), Non Structural Vulnerability Assessment of Hospitals in Nepal, Ministry of Health, Nepal, WHO, NSET, Nepal
14. Guragain Ramesh, Pandey Bishnu Hari, Shreshtha Surya Narayan (2004), Guidelines for Seismic Vulnerability Assessment of Hospitals, WHO, NSET, Nepal
15. Masri S., Caffrey J., Myrtle R., Nigbor R., Agbabian M., Johnson E., Petak W., hinozuka M., Tasbihgoo F., Tranquada R., Wellford L. (2004), The FEMA-USC Hospital Project: Non-structural Mitigation in Hospitals, Paper No. 2480, 13th World Conference on Earthquake Engineering, Vancouver, B.C., Canada
16. Merriman, P. A. and Browitt, C.W.A. Thomas Telford, London, pp.533-546
17. Monti G., Nuti C., Santini S., (1996), Seismic Assessment of Hospital Systems, Paper No 974, Eleventh World Conference on Earthquake Engineering, Elsevier Science Ltd.
18. Norton, J., Chantry, G. (1993), Promoting principles for better typhoon resistance in buildings- a case study in Vietnam. In: Natural Disasters: Protecting Vulnerable Communities, Edited by
19. ODA (1995), , Structures to Withstand Disasters, David Key (Ed.) , Institution of Civil Engineers, Thomas Telford, London
20. PAHO (2008), Hospital Safety Index, Evaluation Forms for Safe Hospitals, Pan American Health Organization, WHO, Washington.

21. Paulay, T, Priestley, M.J.N., (1992), *Seismic Design of Reinforced Concrete and Masonry Buildings*, John Wiley
22. Peduzzi P., Dao H., Herold C., and Mouton F. (2009), *Assessing global exposure and vulnerability towards natural hazards: the Disaster Risk Index*, *Natural Hazards and Earth System Sciences*, Nat. Hazards Earth Syst. Sci., 9, 1149–1159, 2009
23. SAARC DMC (2011), *Rapid Structural and Non Structural Assessment of School and Hospital Buildings in SAARC Countries*, SAARC Disaster Management Centre, New Delhi.
24. The World Bank (2010), *Global Campaign on Making Cities Resilient, South Asia, Global Facility for Disaster Reduction and Recovery*, World Bank's global response to reduce the risks of disasters to sustainable development, New Delhi
25. UNISDR (2010), *Advocacy kit for parliamentarians, Disaster Risk Reduction: An Instrument for Achieving the Millennium Development Goals*,
26. UNISDR, Asia and the Pacific (2010), *One Million Safe Schools and Hospitals Campaign, Guidance Notes, Assessment and Mitigation Planning for Risk Reduction*
27. UNISDR, Asia and the Pacific (2010), *One Million Safe Schools and Hospitals Campaign, Advocacy Guide*
28. UNISDR, Asia and the Pacific (2010), *One Million Safe Schools and Hospitals Campaign, Guidance Notes, School Emergency and Disaster Preparedness*
29. UNISDR, Asia and the Pacific (no date), *One Million Safe Schools and Hospitals Campaign, Guidance Notes, Emergency and Disaster Preparedness for Health Facilities*
30. WHO (2009), *Safe Hospitals in Emergencies and Disasters, Structural, Non-structural and Functional Indicators*, World Health Organization, Regional Office for the Western Pacific.
31. WHO (undated), *Safe Hospitals Checklist*, Pan American Health Organization, Area on Emergency Preparedness and Disaster Relief

The Toolkit is aimed for the policy makers and local bodies that are responsible for local planning usually in urban areas in South Asia in order to assess critical infrastructure safety, particularly making schools and hospital safe.

Tools for the Assessment of School and Hospital safety for Multi-Hazards in South Asia comprised four books:

SCHOOL SAFETY TOOLKIT BOOK 1: NEW DESIGN / MULTI-HAZARD SAFETY COMPLIANCE

SCHOOL SAFETY TOOLKIT BOOK 2: RETRO-MAINTENANCE / MULTI-HAZARD SAFETY COMPLIANCE

HOSPITAL SAFETY TOOLKIT BOOK 1: NEW DESIGN / MULTI-HAZARD SAFETY COMPLIANCE

HOSPITAL SAFETY TOOLKIT BOOK 2: RETRO-MAINTENANCE / MULTI-HAZARD SAFETY COMPLIANCE

This book provides the following four sets of data collection forms: Seismic Safety Evaluation, Wind Safety Evaluation, Flood Safety Evaluation, Fire Safety Evaluation, and Condition Assessment. The surveyors/users should read these forms before initiating the investigation for retrofitting. Only the relevant forms should be used for examining safety compliance of the existing building since all four hazards may not be applicable in every site.

Lead Technical Advisor for the development of the Toolkit, Dr Prabir Kumar Das is primarily working in India and the region of South Asia promoting community based social infrastructure construction consulting Governments, UN agencies and private sectors. His specific technical experience is in project appraisal, planning, implementation and maintenance management of community based construction, specially, education and healthcare facilities.



WORLD URBAN CAMPAIGN
Better City. Better Life

SUPPORTED BY



GFDRR
Global Facility for Disaster Reduction and Recovery

